



**THE HONG KONG
INSTITUTION OF ENGINEERS
ELECTRICAL DIVISION**

The 27th Annual Symposium

Thursday

22nd October 2009

ENGINEERING THE CHANGES

at

Ballroom
Sheraton Hotel
Nathan Road
Kowloon
Hong Kong

SYMPOSIUM PROGRAMME

08.30 Registration and Coffee

09.00 Welcome Address

- Ir Simon F.W. Chung
Chairman, Electrical Division, The HKIE

09.05 Opening Address

- Ir Dr F.C. Chan
Vice President, The HKIE

09.10 Keynote Speech

- Professor Andrew McCusker
Operations Director
MTR Corporation Limited

1. Carbon Reduction

09.40 A Technology Roadmap Towards a Low Carbon Electric System

– A Utility's Experience Sharing

- Ms Priscilla P.S. Lee, Energy Technologist
- Ir Dr John W.M. Cheng, Program Development Manager
- Mr C.C. Ngan, Innovation Architect
CLP Research Institute Ltd.
- Mr Andrew Kinross, Director/Energy
Navigant Consulting, Inc.

**10.00 Green Technology Applications to Combat Climate Change -
An Electrical Engineering Perspective**

- Ir Dr F.C. Chan
General Manager
CLP Engineering Ltd.

10.20 Discussion

10.40 Coffee Break

2. Emerging Technologies

11.10 State-of-the-art Batteries for Electric Vehicle and Industrial Applications

- Mr Kevin K.M. Yiu
Business Development Director
EVB Technology (HK) Limited

11.30 Enhanced System Reliability – Perspective from Distribution Cable/Materials

- Dr Peter K. Pang
End-Use Marketing Manager
Dow Wire & Cable
Dow Chemical (China) Investment Co. Ltd.

11.50 Contemporary Design of Electrical and Vertical Transportation Systems for Super High-rise Buildings in Mainland China and Hong Kong

- Ir H.K. Yung, Director
Ir Tony C.F. Lau, Associate Director
Ir Tony C.W. Leung, Associate
J. Roger Preston Ltd., Hong Kong

12.10 Discussion

12.30 Lunch

3. Asset Management

14.15 Smart Use of System Control Statistical Data to Enhance Power System Operations

- Mr Dennis K. Wong
Vice President, Business Development
ASAT Solutions Inc., Canada

14.35 Fibre Bragg Grating Sensor Networks for Condition-Monitoring of Railway System

- Professor H.Y. Tam
Director
Photonics Research Centre
The Hong Kong Polytechnic University

14.55 Discussion

15.15 Coffee Break

4. Migrating to New Era

15.45 Evolution in Electrical Engineering Curriculum

- Ir W.K. Lee, Senior Teaching Consultant
- Ir Dr Wilton W.T. Fok, Senior Teaching Consultant
- Ir Professor K.T. Chau, EE Programme Director
- Ir Professor Felix F. Wu, Chair Professor
Department of Electrical and Electronic Engineering
The University of Hong Kong

16.05 2009 Edition of Code of Practice for the Electricity (Wiring) Regulations

- Ir Y.H. Leung, Senior E&M Engineer
- Ir Y.T. Wong, E&M Engineer
Electrical and Mechanical Services Department
The Government of the HKSAR

16.25 Discussion

16.45 Summing Up

- Ir S.K. Ho
Symposium Chairman
Electrical Division, The HKIE

Closing Address

- Mr Ricky W.K. Wong
Chairman
Hong Kong Broadband Network Limited

Acknowledgement

The Electrical Division of The Hong Kong Institution of Engineers would like to express its sincere appreciation and gratitude to the following persons and organizations for their contributions to the Symposium :

Speakers / Authors

Professor Andrew McCusker	Ir Tony C.F. Lau
Mr Ricky W.K. Wong	Ir Tony C.W. Leung
Ir Dr F.C. Chan	Mr Dennis K. Wong
Ms Priscilla P.S. Lee	Professor H.Y. Tam
Mr John W.M. Cheng	Ir W.K. Lee
Mr C.C. Ngan	Ir Dr Wilton W.T. Fok
Mr Andrew Kinross	Ir Professor K.T. Chau
Mr Kevin K.M. Yiu	Ir Professor Felix F. Wu
Dr Peter K. Pang	Ir Y.H. Leung
Ir H.K. Yung	Ir Y T. Wong

Sponsors

Siemens Ltd.
CLP Power Hong Kong Ltd.
The Hongkong Electric Co., Ltd.
MK Electric (China) Ltd.
Junefair Engineering Co. Ltd.
Kum Shing Group
The Jardine Engineering Corporation Ltd.
Keystone Electric Wire & Cable Co. Ltd.
MTR Corporation Ltd.
Mitsubishi Electric (Hong Kong) Ltd.
Greenland Engineering Co., Ltd.
Tyco Electronics Hong Kong Ltd.
Wenden Engineering Service Co., Ltd.
Metrix Engineering Co., Ltd.
Chat Horn Engineering Ltd.
NWS Engineering Group Ltd.
The Hong Kong & Kowloon Electric Trade Association
Hong Kong Electrical Contractors' Association Ltd.

Cover Design of this Booklet by Ir Dr F.C. Chan

27TH ANNUAL SYMPOSIUM ORGANIZING COMMITTEE

Symposium Chairman	:	Ir S.K. Ho
Members	:	Ir Simon F.W. Chung
		Ir Geoffrey L. Chan
		Ir Dr K.M. Leung
		Ir Gary C.W. Ko
		Ir C.S. Ho
		Ir Albert W.K. To
		Ir Gordon M.S. Woo
		Ir David C.M. Yuen
		Ir C.L. Wong
		Ir Y.H. Chan
Hon. Secretary and Treasurer	:	Ir Y.K. Chu

Note :

All material in this booklet is copyright and may not be reproduced in whole or in part without written permission from The Hong Kong Institution of Engineers. The views expressed are not necessary those of the Electrical Division or the Institution.

Paper No. 1

**A TECHNOLOGY ROADMAP TOWARDS A LOW CARBON
ELECTRIC SYSTEM – A UTILITY’S EXPERIENCE SHARING**

**Speakers : Ms Priscilla P.S. Lee, Energy Technologist
Ir Dr John W.M. Cheng, Program Development Manager
Mr C.C. Ngan, Innovation Architect
CLP Research Institute Ltd.
Mr Andrew Kinross, Director/Energy
Navigant Consulting, Inc.**

A TECHNOLOGY ROADMAP TOWARDS A LOW CARBON ELECTRIC SYSTEM – A UTILITY’S EXPERIENCE SHARING

Ms Priscilla P.S. Lee, Energy Technologist
Ir Dr John W.M. Cheng, Program Development Manager
Mr C.C. Ngan, Innovation Architect
CLP Research Institute Ltd.
Mr Andrew Kinross, Director/Energy
Navigant Consulting, Inc.

Paper
No. 1

ABSTRACT

The power industry is confronted with the urgency of climate change, environmental concerns and regulatory pressure to move towards a low carbon environment. In the face of these emerging issues, utilities are turning to clean energy and technological innovations to lower carbon emissions. This paper presents a power utility’s experience in developing a technology roadmap for the transition to a low carbon electric system. As the issue of climate change does not have a silver bullet solution, a portfolio approach was used to identify a range of key technologies to achieve low carbon energy. The spectrum of technologies includes renewable energy resources, carbon capture and storage, as well as green and innovative energy services.

1. INTRODUCTION

The environmental challenges faced by today’s power industry are quite daunting. The issue of climate change in particular requires that the industry respond quickly to avoid irreversible impact. There are few existing solutions but a range of new technological solutions are emerging in the horizon. In order to deploy the technologies effectively to address climate change, technology planning is critical. One tool for technology planning is a technology roadmap ^[1]. This paper offers a look at how one utility develops a technology roadmap to strategize its approach for addressing climate change.

2. WHAT IS A TECHNOLOGY ROADMAP?

A technology roadmap is a tool used to identify the critical technologies necessary for meeting specific objectives. Such a roadmap can have different applications under various settings. An industry may use a technology roadmap to identify and address technology challenges for the future development of the sector. A company may use a technology roadmap to establish the framework for developing a particular new product.

Some examples of technology roadmaps used in the energy sector include those developed by Electricite de France (EDF) and Continental Automated Buildings Association (CABA). EDF R&D through its Demand Response Technology Roadmap identified the controls, internet standards, and tariff structures that will help the development of demand response and smart homes ^[2]. The CABA technology roadmap describes the current and evolving intelligent building technologies, such as intelligent lighting, voice and data communications, and energy management systems. CABA also uses its technology roadmap to recommend actions for the building industry to promote the application of intelligent building technologies ^[3].

Although there is no standard structure for the technology roadmap process, the development of a roadmap typically begins with a vision of a future scenario, challenge, or issue that can not

be addressed with existing technologies. Then the technologies that are essential to closing the gap between now and the future are identified and prioritised. In other words, a technology roadmap is a strategic approach towards a future objective.

3. EXPERIENCE OF DEVELOPING A UTILITY’S TECHNOLOGY ROADMAP

3.1 OBJECTIVE

Power utilities worldwide are facing the issue of climate change. One approach to addressing this issue is by developing a technology roadmap that identifies the technologies needed for transforming a largely conventional fuel portfolio to one that uses low-carbon technologies.

As a major power utility operating throughout the Asia-Pacific region, CLP has set aggressive carbon emissions intensity reductions target through its Climate Vision 2050 initiative [4]. Through the initiative, the company committed to a 75% reduction in carbon intensity relative to year 2007 emissions. The company developed a technology roadmap that outlines the key technologies that will be important for transforming to a low-carbon portfolio. This paper shares the experience of developing such a roadmap.

3.2. METHODOLOGY

The development process began with the identification of a broad range of technologies that can potentially impact the power industry. These identified technologies became the basis of the Technology Atlas; that is all those innovations which should be monitored for developments.

While a spectrum of potential challenges facing the power industry was considered, climate change was one of the significant issues that called for a targeted low-carbon technology roadmap. Selective innovations from the Technology Atlas that can

significantly mitigate the climate change challenge from a utility standpoint were integrated into the low-carbon technology roadmap.

As a first step to identifying and prioritizing the technologies and innovations that could potentially impact the power industry, we took the “universe” of technologies and put it through a screen to identify which ones would be best suited to meet the company’s needs. Key criteria that were considered included the following:

- Time to commercialization
- Potential for market transformation
- Potential for strategic value to the company

We scored 80 technologies in all, based on a scoring system that defined how each technology would be scored and ranked with the goal being to identify the key technologies that most likely contribute to solving the challenges set out by the company.

Thirty-six technologies were short-listed from an original list of 80. We developed profiles of each of these technologies. After gaining insights and a deeper understanding of the potential of the different technologies from this exercise, we then conducted another screen to find out the technologies that were really going to be the critical ones in the roadmap. Following that selection we developed reports one level of detail greater than the prior reports.

While the *mechanics* of the scoring and ranking ended up being a relatively straightforward exercise, the *insights* gained from the research on the potential impact of the different technologies was considerable. The scope of the researched topics is described in the subsequent section.

3.3 SCOPE

Extensive research was conducted for each technology and innovation identified as having significant potential impact on the power industry. To help us better understand the development of the technologies, we analyzed factors ranging from market drivers to

development enablers and barriers. The scope of analysis for each technology and innovation are described below.

3.3.1 DRIVERS

These are the main drivers of developing and utilizing such a technology. For example, the drivers of *smart grids* would include preventing blackout, accommodating widespread deployment of intermittent distributed energy resources, growing needs to engage and accommodate customer-side interactions, requiring high efficiency, reliability and power quality for the digital age, climate-change and long-term business competitiveness considerations ^[5,6].

3.3.2 POTENTIAL FOR MARKET TRANSFORMATION

Each technology included in the Atlas must have a certain level of potential to transform the industry. By means of transformation, we mean the new technology could do at least one or more of the following: 1) Add new value(s) to the customers/service provider; 2) Enable the conducting conventional business in a substantially more effective and efficient way; 3) Reduce the cost of the product/service significantly; and 4) Reduce the impact to the environment at an affordable cost. In fact, we realize different technologies could offer different types of transformation with different level of impact. Therefore, this section is to highlight the condition and reasons how a technology could transform the industry. We also assigned a High/Medium/Low to gauge the impact. For instance, *hydrogen-based applications* are still being developed currently. When hydrogen is produced by electrolysis, the low energy conversion efficiency is an obstacle. When hydrogen is used in stationary fuel cells for electricity generation, the high cost of fuel cells also remains a challenge. As such, the hydrogen technology is considered as Low at the moment ^[7].

3.3.3 ECONOMICS

This is the economic overview/assessment of a

technology. We examine the cost and benefit of how the new technology can either replace or add to the existing market. It includes the cost trends and some projection if available. It is understood that all technologies we examine are not in a wide-spread deployment phase hence the detailed economic analysis are not necessary complete. However, we would try to use the most reliable and credible authorities such as International Energy Association (IEA), government reports and forecasts to estimate the likely trends and future paths. For example, *New Building Commissioning* is an approach which can make a new building to function efficiently and hence that could reduce a lot of wasteful consumption/emission. It was shown that in 2004, Lawrence Berkeley National Laboratory in the US released an analysis based on 20 years of data, that median commissioning costs for new buildings was US \$1 per square foot (0.6 percent of total construction costs), yielding a median payback period of 4.8 years if the technology is used ^[8].

3.3.4 ADVANTAGES AND DISADVANTAGES

We use simple bullet form to highlight the pros and cons of implementing such a technology/innovation. For example, *synchronous condensers* can provide dynamic voltage support to uphold the system voltage and help improve reliability and vulnerability. However, its advantages and disadvantages could include:

- Able to cushion the effect of abrupt changes in grid system conditions
- Does not produce harmonic current that disturbs system performance
- Long lifespan, given proper maintenance
- Restrictions on deployment site locations
- Bulky, noisy and heavy hardware
- Sensitive to moisture, chemical contamination and dirt

3.3.5 ENABLERS AND BARRIERS

Wide-spread adaptation of a technology in any industry or the rejection of it does not merely

depend on cost alone. The enablers and barriers here provide some other technical and non-technical considerations which can make or break the taking-off of a technology. Quite often, the regulatory environment and market competition will play a key role in this. For example, for *geothermal generation*, these are the enablers and barriers:

- Policies promoting use of renewable energy
- Government grants of exploration licenses and development rights
- Advancement in rock drilling technology
- Permitting, legal, and environmental issues of enhanced geothermal systems (EGS) development
- High capital cost for EGS relative to natural gas plant
- Mismatch between geothermal sources and load centres

3.3.6 ALTERNATIVE/COMPETING TECHNOLOGIES

For considering a technology, we would also look at the alternatives and competing products. This is a different dimension from the cost as some technologies may offer multiple values to the customers/service providers and subsequently beating out the lower cost option.

For example, for *flue gas desulphurization*, the alternatives include burning low-sulfur coal and using multi-pollutant controls in power plants.

3.3.7 HOW IT WORKS

We consider it very important to establish an accurate and comprehensive understanding of the technology. Due to the rapidly changing technological development and proprietary issues, the description of each technology will give a snapshot of the key components or support needed to make the technology function and integrate with the rest. Here we provide an example description for *heat pump water heater (HPWH)*:


- HPWH transfer heat from the surroundings into the water tank. HPWH use electrically driven compressors to drive a vapour

compression cycle using conventional refrigerant as the working fluid. Newer HPWH use CO₂ as the working fluid to achieve higher water temperatures. In indoor applications HPWH have a cooling effect that may be beneficial in warm climates.

3.3.8 TECHNOLOGY STATUS

We use a graphical depiction similar to Figure 1 to summarize the current stage of the technology. Typically, there are four stages: 1) R&D phase - meaning the technology is in early stage of development which focus on basic and application research; 2) Demonstration phase - the technology is deployed for first commercial-scale applications; 3) Deployment phase - the technology is being wide-spread deployed and/or in large-scale application; and 4) Commercialization phase - the technology is available on the market but may be still expensive in comparison to conventional or alternative technologies.

Figure 1 Example Technology Status Timeline

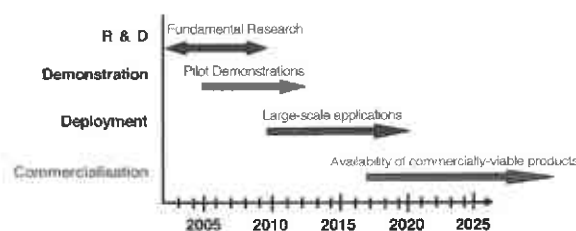

3.3.9 R&D OBJECTIVES

We propose or highlight some of the R&D needs and trends within the industry as well as in the academics. It also serves to illustrate where some of the weak links are in the new technology. For instance, the followings are the R&D objective for *smart appliances*:

- Incorporate price signal reception capabilities into the system design
- Develop inexpensive technological solutions for retrofitting existing homes
- Integrate with other aspects of home automation systems (e.g., communications, entertainment, and security)

3.3.10 KEY DEVELOPMENTS/ DEMONSTRATIONS

In this section, we collect and summarize the key demonstration projects and/or product developments for the specific technology. As these demos and projects/programs have a wide variety, it may be best to illustrate with an example like in the *solid-state lighting* technology:

- In August 2008, the Summer Olympics in Beijing adopted LED lighting technology with the budget of about RMB¥ 0.5 billion and the estimated electricity savings of some 750MWh per year. The “Bird’s Nest” featured LED-lit signage and energy efficient lighting from various vendors. The “Water Cube” featured approximately 440,000 AAA XLamp LEDs embedded in the facade and structure of the building. BBB provided CFL, LED and solar-powered LED streetlamps for use on Olympic Buildings and around venues ^[10].

3.3.11 KEY DEVELOPERS/RESEARCH ORGANISATIONS

This section includes the information of prominent/major entities who are either the technology provider, utility off-taker and/or developer; the location and commission date, capacity and application type.

3.3.12 POTENTIAL STRATEGIC VALUE TO THE COMPANY


Finally, but not least, we conclude whether each of the technologies will be strategically important to the business, mainly from the perspectives of the maturity of the technology and its applicability.

3.4 TECHNOLOGY ATLAS

Given the above mentioned scope and criteria, we collect, review and analyze a broad range of technologies covering generation, delivery, emission control, operation and maintenance, environmental, storage, power electronics, energy efficiency, end-use, transportation and others. For each of the technology, we classify them into Research & Development, Demonstration or Commercialization stage and

then project the time duration for the development of each of these stages for the specified technology. At the end, a technology atlas similar to Figure 2 is obtained.

Figure 2 Technology Atlas of Different Technologies

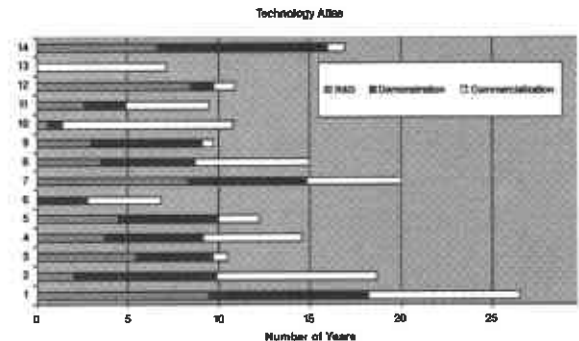

From the Atlas, we can have a global view on which technology is closer in range to become commercially available and likely be competitive. In addition, we may also observe the likely relationships among the technologies (whether they are complementary or competitive to each other).

3.5 TECHNOLOGY ROADMAP

Based on the analysis conducted for the Technology Atlas, we examined the technologies and innovations that can significantly reduce carbon emissions and integrated these into the low-carbon technology roadmap. The low-carbon technology roadmap includes technology categories such as renewable energy and green energy and services.

The technology roadmap we have developed so far is high level and in broad terms. More efforts and works are necessary for detailed maps of those identified technology groups. Moreover, the technology roadmap itself and the preparation process have laid down a platform to facilitate on-going communication, engagement and consideration of technological matters at corporate levels.

In general, when developing a technology roadmap for individual organisations, each entity will need to consider its own relevant

factors for evaluating the applicability of different technologies. Each organisation will also need to determine the suitable approach for managing technologies at different development stages. As technology development is rapid with many uncertainties, the roadmap will have to be updated and modified periodically based on the latest regulatory, market and technology environment.

4. CLOSING REMARKS

A technology roadmap is a useful tool for addressing large-scale challenges, such as climate change, that do not have a silver bullet solution. The approach presented in this paper is one example of the technology roadmap development process. Each organization will need to determine the technology types that are most applicable to it, such as the maturity of technology and the associated risks. Lastly, developing a technology roadmap is not a one-time process but rather a process that should be revisited periodically.

5. ACKNOWLEDGEMENT

The authors would like to express their gratitude to CLP’s management in supporting this work, particularly Dr. Gail Kendall who provided the initiative and continuous guidance along the entire project. Dr. Kendall retired from CLP in 2008.

REFERENCE

- [1] CLP, *CLP Technology Roadmap - transforming the portfolio through innovation*, published in November 2008 <https://www.clpgroup.com/Abt/Res/Pub/CLPGroup/Pages/CLPTechnologyRoadmap.aspx>
- [2] EDF R&D, *Demand Response Technology Roadmap*, retrieved on 10 August 2009 from [http://rd.edf.com/fichiers/fckeditor/File/Dherbecourt-Technology Roadmap DR 28th May 2009 V1.1.pdf](http://rd.edf.com/fichiers/fckeditor/File/Dherbecourt-Technology%20Roadmap%20DR%2028th%20May%202009%20V1.1.pdf)
- [3] Continental Automated Buildings Association, *Technology Roadmap for Intelligent Buildings*, retrieved on 10 August 2009 from <http://www.caba.org/trm>
- [4] CLP, *CLP’s Climate Vision 2050 - Our Manifesto on Climate Change*, retrieved on 10 August 2009 from <https://www.clpgroup.com/Abt/Res/Pub/CLPGroup/Documents/CLP’s%20Climate%20Vision%202050.pdf>
- [5] US Department of Energy (DOE) Smart Grid website, retrieved on 9 December 2009, from <http://www.oe.energy.gov/smartgrid.htm>
- [6] Smartgrid website, retrieved on 10 December 2008, from http://www.smartgrids.eu/documents/sra/sra_finalversion.pdf
- [7] IEA, *Energy Technology Essentials - Hydrogen Production & Distribution*, retrieved on 9 December 2009, from www.iea.org/Textbase/techno/essentials5.pdf
- [8] Bourassa, Norman et al., *A Meta - Analysis of Energy and Non - Energy Impacts in Existing Buildings and New Construction in the United States*, retrieved August 1, 2007, from <http://eetd.lbl.gov/emills/PUBS/PDF/Cx - Costs - Benefits.pdf>

Paper No. 2

**GREEN TECHNOLOGY APPLICATIONS
TO COMBAT CLIMATE CHANGE
- AN ELECTRICAL ENGINEERING PERSPECTIVE**

**Speaker : Ir Dr F.C. Chan
General Manager
CLP Engineering Ltd.**

GREEN TECHNOLOGY APPLICATIONS TO COMBAT CLIMATE CHANGE - AN ELECTRICAL ENGINEERING PERSPECTIVE

Ir Dr F.C. Chan
General Manager
CLP Engineering Ltd.

ABSTRACT

This paper examines various green technologies that we can adopt to combat with the climate change. By enhancing energy efficiency and 'do more with less' a better utilization of energy can be achieved. In this paper, the focus on green technology is mainly related to the equipment in the electrical engineering areas for end-user applications. These technologies include lighting, heat pumps, control system, induction cooking, motoring and small scale renewable. Their anticipated energy saving potential is also reviewed. To have a systematic approach, energy and carbon audits is the first step to identify improvement areas. Once these improvement areas can be identified, implementation considerations can then be followed. Finally, the effectiveness of each of these technologies can be further reviewed.

1. INTRODUCTION

Green technology is the applied science and engineering to conserve the natural environment and resources to enable a sustainable future. In applying green technology as a solution, it should be economically viable and environmentally sound. For the preservation of the environment, there are two approaches:

- (a) in the energy saving journey, there are two ways: 'don't waste when not in use' and 'do more with less'. In both of these cases, energy efficiency and energy utilization effectiveness can be achieved.
- (b) in the renewable energy aspect, 'free energy' could be obtained. However, this normally involves capital investment which may not have a short payback period.

Before considering any green technologies, it is essential to carry out energy and carbon audits so that we know where we are. By establishing a baseline, we can then identify improvement opportunities and hence the required applications for better energy utilization.

2. ENERGY AND CARBON AUDITS

2.1 ENERGY AUDIT

Energy audit is an examination of an energy consuming equipment/system to ensure that energy is being used efficiently. It looks for Energy Management Opportunities (EMOs) for improvement. There are two types of energy audit: Walkthrough Energy Audit and Detailed Energy Audit, varying by the breadth and depth of the examination^[1]. Walkthrough Energy Audit is like a general health check to review the general conditions of the energy equipment/system, operation and maintenance practices, identify and prioritise these EMO and make coarse estimate of the benefit and cost of its implementation. Detailed Energy Audit is carried out on specific equipment or system focusing on its energy efficiency performance. The more complex and high-benefit-high-cost EMOs identified from walkthrough energy audit can be further examined and assessed in the detailed energy audit. This detailed energy audit is to understand the uniqueness and characteristics of the building and its system usages. Detailed analysis of historical system operating data and comprehensive field measurement on related energy efficiency performance are required. As the term 'Energy Audit' has been vaguely

used, a more specific term 'Energy Efficiency Assessment' is proposed to give a more specific focus.

2.2 CARBON AUDIT

Carbon audit is a means of measuring and recording the organization's emissions of greenhouse gases (GHG) - notably the carbon dioxide CO₂ (or the greenhouse gas's CO₂ equivalents). It is essential that if we want to reduce CO₂, we must establish a baseline to measure and hence control. The procedure to carry out carbon audit can follow the guidelines issued by the EMSD of the HKSAR Government to account for and report on GHG Emission and Removals for Buildings (Commercial, Residential or Institutional Purpose) ^[2].

Carbon audit starts by determining the physical boundaries of the concerned building where the organization is situated. Following that, the operational boundaries are also determined based on the organization's operational activities. These boundaries defined the area where relevant data can be collected, for example, lighting, air-conditioning, machinery, office equipment, industrial processes, fuel used, waster disposal etc. Under the guidelines, GHG emissions are categorized under three different scopes.

Scope 1 is to deal with the direct emission from sources and the removals by sinks. These include: Combustion of fuels in stationary sources, Combustion of fuels in mobile sources, Fugitive emissions and Removals of greenhouse gas. Scope 2 covers indirect emissions when using energy sources from electricity or gas. Scope 3 covers indirect emissions for those activities the organization required to conduct their business. Scope 3 activities may be implicit in nature and some quantification tables are required in order to calculate its emission equivalent. Other common activities under Scope 3 include: Transportation of purchased goods and materials, Employee travels, and Outsourcing.

After collecting all relevant data based on the defined scope 1 to 3 elements, the GHG

emission quantity can be calculated with relevant to some published conversion factors. As data collection process might be carried out by a number of parties, it is essential to validate such data and hence their meanings so derived. After calculating the emission quantity, the qualified engineer is to prepare the report which also includes an appropriate carbon reduction plan to improve and reduce the organization existing carbon emission. It is a great challenge for conducting the first carbon audit and setting out the associated reduction plan.

After carrying out energy and carbon audits, a list of potential improvement areas can be identified. Based on the audit results, we can prioritize the items for enhancement. These improvement areas normally include the following system and equipment: lighting, mechanical ventilation and air conditioning, lifts and escalators, water and space heating, cooking, control and energy management systems, building design and finally, renewable energy installation.

3. GREEN TECHNOLOGY APPLICATIONS

Green technology is the application of the environmental science to conserve the natural environment and resources, and to curb the negative impacts of human involvement. In 2008 Chief Executive Policy Address, Clause 95 stated that "We will make early preparations to meet the challenge of climate change. In Particular, we will enhance energy efficiency, use clean fuels, rely less on fossil fuel and promote a low carbon economy - an economy based on low energy consumption and low pollution." It is therefore essential that we need to look for product and technology with better efficiency and lower carbon emission. The following is a brief review of various green technologies focusing on the technology trend and energy saving potential.

3.1 LIGHTING

Lighting contributes quite a major portion of

energy usage and is one of the areas where easy energy reduction can be achieved. With the advancement of LED technology in recent years, the use of LED lamp becomes more widespread and popular due to its long service life (50,000 hours), versatile colour changing ability and low power consumption (recently up to 100 to 120 lumen per Watt). LED has no filament or breakable glass bulb with very little heat generated. Owing to the very core technology of the semiconductor chip is still under 3 or 4 global companies' control, the price of LED is still high at the moment. Nevertheless, with increasing popularity of general lighting purpose application, more players will enter into the manufacturing market and eventually drive down the LED price.

Lantern replacement by higher light output ratio lighting fittings can be a straight forward approach, particularly where incandescent lamps replacement by high efficient lamp sources in some countries are mandatory. With the development LED technology which is the future of lighting, complete replacement of conventional lighting is not far away. Of course, re-design the lighting provision based on the LED characteristics may be required. Care must be taken in the LED provision because of its colour changing capabilities as additional lighting might be provided to demonstrate the vivid of a metropolitan city.

Yet, if replacement and maintenance cost is included and disturbance to users is considered, it is not difficult to get a payback period of less than 2 years for some difficult access areas like high ceiling. Besides, lighting control technology has been growing rigorously these few years with digital and addressable control, wireless communication and built-in occupancy sensor and controls. The role of lighting control is getting more and more important. The use of photo sensors and programmable logic controllers can further enhance the energy saving performance of lighting system.

The potential energy savings under this category include:

- Compact Fluorescent Lamps to replace incandescent lamps (save ~80%)
- Energy efficient fluorescent tubes (electronic ballasts, T5 tubes) to replace electromagnetic ballasts & T8 tubes (~30%)
- LED exit signs to replace conventional exit signs that use fluorescent tubes (~80%)
- Coated reflector - achieving comparable lighting level using specially coated reflector but with less lamps (~30%, depending on the number of lamps removed.)

3.2 MECHANICAL VENTILATION & AIR CONDITIONING (MVAC)

Oil-free chillers with magnetic drive compressor which could eliminate oil contamination and minimize friction could improve the Coefficient of Performance (COP) from traditional figures of 5 ~ 6 to 10 ~ 12 under a partial load condition⁽³⁾. Besides, variable speed chillers, predictive system curve control for secondary pumps could also raise the system COP significantly. Other new technology on low pressure and temperature cooling towers and thermal storage are now available in the MVAC market. Besides, chiller controls are now mature and can effectively communicate with the Building Management System to enable suitable amount of cooling capacity is being generated and flown to the required with minimum energy loss.

Energy evaluation by different energy models also shows that the central seawater scheme (seawater cooled) and cooling tower scheme (fresh water cooled) are more energy efficient than the conventional air-cooled air-conditioning scheme. Of course, such increase in the energy efficiency depends on the building type, air-conditioning plant configuration and piping layout. Water cooled chillers can provide better efficiency than the air-cooled ones. Fresh water cooling towers can provide a more effective solution as using copper tubes in the condenser can achieve a higher efficiency. The use of variable speed

drives in fans and pumps also enhance the system efficiency.

The potential savings under this category are:

- Water-cooled chillers to replace air-cooled chillers (save ~30%)
- Automatic tube cleaning system that keep heat exchange surface in chiller efficient heat transfer (10~15%)
- Variable speed fans and pumps (e.g. Variable speed drive (VSD) for secondary chilled water pumps, VSD for regulating supply & exhaust air fans through detecting CO₂ or CO concentration) (10~30%)
- Heat wheel to recapture energy from cooled exhaust air stream to supply air stream (Recover ~40% energy)
- Proper air-balancing (ratio between exhaust & make-up air) in kitchen to reduce cooled air escape through kitchen exhaust (case varies, depending on level of shortfall in makeup air)

3.3 LIFTS AND ESCALATORS

The advancement in energy efficiency for lifts and escalators is largely attributable to the improvements in electric motor technology, power electronics and intelligent control system. The most commonly used induction motors are now coupled with variable-voltage-variable-frequency (VVVF) drives, allowing the motors to operate at optimal efficiency at different load and speed. Some newer designs feature permanent magnet motors and regeneration devices to reduce power transmission losses and re-feed braking energy into the electrical distribution network rather than dissipated as heat.

Some forms of intelligent lift management system would pool and analyze service requests, then coordinate the lift movements so that the requests could be met responsively while minimizing energy consumption^[4]. The application of double-deck lifts is one example to optimize traffic flow. Other intelligent control system commonly found in escalator applies proximity detectors at the entrance and

exit points. It runs the unit only when it “sees” there are passengers to be served.

The potential savings under this category are:

- Variable voltage variable frequency drive for regulating escalator’s motor torque and speed at light load (save ~10%)
- Intelligent detection system for escalator (case varies, depending on utilization pattern)

3.4 WATER AND SPACE HEATING

Heat pump technology has a very long history of more than 100 years. In fact, the heat pump cycle is exactly the same as the refrigeration cycle except that the useful heat energy lies on the condenser side. With the adoption of better refrigerants, high efficiency heat pumps (COP around 8) and high temperature heat pumps (output water temperature up to 90°C)^[5] are being developed for various applications.

Many commercial and industrial processes demand hot water. Different kinds of energy efficient water heating system exist. Apart from the more common air-to-water heat pumps and water-to-water heat pumps, it is not unusual to find many newer designs are bundled with solar water heaters^[6] or designed to extract heat from free energy sources like waste heat of industrial processes or condensing water of chillers. For the latter case, it may even improve the chiller COP because of the lowering of condensing water temperature after heat extraction.

The potential savings under this category are:

- Heat pump water heaters to replace direct heating electric or gas-fired boilers (save ~70%)
- Fuel-fired boiler air-fuel optimization controller to ensure complete combustion and minimizing heat loss caused by over supply of air (~5%)
- Heat recovery device (optimizer) at flue gas exhaust of fuel-fired boiler for process water / process air pre-heating (~5%)

3.5 INDUCTION COOKING

Electric induction heating technology is a mature technology that has been around for decades. But it was not until its broad appearance in the domestic and commercial cooking applications that its supreme energy efficiency (>3 times) than fuel-fired technology is being publicly recognized.

Induction cooking equipment was first seen with unit rating seldom exceeded 5kW and all were having flat ceramic glass cook-top. With the advancement in material, power electronics and manufacturing technologies, much higher power rating (>35kW), stronger and curved cook-top equipment appeared. The latter is a particularly important development as using curved wok is key to many traditional Chinese cooking methods. Its presence removes a barrier of switching electric induction cooking amongst Chinese chefs and thus, has led to a significant amount of energy saving in the food catering sector.

In terms of energy saving, electric induction cooking is more efficient than the gas-fired cooking. Electric induction cook-tops, woks and stoves to replace equivalent gas-fired equipment can save energy of some 60 to 80%. In addition, a healthier, less hot and quieter kitchen environment can be provided.

3.6 BUILDING ENERGY MANAGEMENT

Being a tool to achieve building energy saving, the success of a Building Energy Management System (BEMS) would rest on the availability, adequacy and accuracy of the building operating data and the intelligence of the BEMS processing core.

On the data acquisition side, wireless technologies have made it easier and more cost-effective to establish two-way communication between the BEMS core and the services facilities. Wireless BEMS are actually built on-top of well-established wireless computer networking and telecommunication protocols. These networks have the intelligence to dynamically alter their logical topology to assure reliable

data communications.

At the processing core, some advanced BEMS will have self-learning and predictive capabilities. It will analyze historical facility operating data, predict changes in operating conditions, formulate the optimal responses under various scenarios, and then issue control commands to end facilities to meet various control objectives such as minimizing overall energy consumption over a period of time or limiting the peak electricity demand at any shorter interval.

A simple form of BEMS may have only distributed hardware like timer switches, occupancy sensors, photo sensors that keep air-conditioning or lighting active only when needed; and with hardware & software for monitoring and controlling of only the major equipment. This simple BEMS is already ready to deliver energy saving but the potential would vary from case to case.

In the building design aspect, application of solar film on windows or double glaze windows to shield against incident heat from incident sunlight but allow light to pass through can save energy on air-conditioning. It is estimated that some 70% of the heat can be blocked. Green roof and green wall is another approach where culturing plants at roof top to reduce heat transmitted from roof^[7]. The effectiveness depends on building locality, geometry and orientation

3.7 RENEWABLE ENERGY

Renewable energy is normally sustainable and energy efficient. Its viability depends on the availability of the resources. In the case of Hong Kong, solar and wind power are the two most popular renewable energy applications.

For solar energy, photovoltaic (PV) panels can be installed on roof to transform solar energy into electrical energy. The energy can be grid-connected for other application usage. In distributed renewable energy applications for buildings, solar thermal technology is customarily used for space and water heating whereas solar PV for electricity generation.

Instead of relying on solely solar energy for water heating, hybrid system using heat pumps and solar water heaters would be more appropriate for typical buildings in HK. Like serviced-apartments and hotels, where roof space is limited but hot water demand is high, running a solar thermal system as an assisting unit to the main heat pump-based system could be one of the most practical approach of applying renewable energy in HK.

For the PV technology, the power density and its conversion efficiency remain limited and may take some years of development before it can substitute purchased electricity to any appreciable extent. Nonetheless, progresses in crystalline silicon cell and wafer production technologies have boosted the technical and economical viability of Building Integrated PV (BIPV) system.

Small scale wind turbines are also suitable for building roof-type applications. Wind turbines turns wind energy into electrical energy and again connected back to the system for other electrical appliances. Normally, the power output is low and is suitable for light load application such as lighting. A combination of wind turbine and solar panels are common for some outdoor lighting poles applications.

3.8 ELECTRIC VEHICLES

In a modern city, high rise building equipped with high energy efficiency building and transportation is essential for sustainable development. Although the acceptance of full battery powered electric vehicles (BEV) is limited by the available battery energy density, the development of the Hybrid Electric Vehicle (HEV) taking the merits of the conventional propulsion system with an electric propulsion system are essential. It allows a longer driving range and offers better fuel economy, e.g. energy can be saved by regeneration during braking and down slope driving. In battery development, new energy storages using Ni-MH, Li-ion batteries and ultra-capacitor are being actively developed. Performance can be further enhanced with the combination of Li-ion and ultra-capacitor with the ultra-capacitor delivering an extra short time power

for acceleration^[8]. The deployment of electric vehicles has to be supported by good charging infrastructure and services. Charging can be carried out by the following types: domestic charging, commuter charging and public charging. Electric vehicles are definitely an area where low carbon economy will base upon.

4. ENERGY SAVING STRATEGY-BASE LOAD APPROACH

For new buildings, there will be less technical constraints on the choice of energy equipment and therefore energy efficiency could be more easily achieved. But for old buildings, adopting new technology could be more costly as there would be more system integration and implementation issues to be resolved.

If both financially and physical site conditions allows for a complete system replacement, it is always recommended to capture every energy saving opportunities. However, if a full replacement cannot be carried out, one could go for partial implementation to achieve the best saving out of the available capital. This approach is also known as “base load” approach.

From energy audit, one should try to identify the load pattern for heating, cooling and even lighting systems. From the load pattern, “base load” can be identified: for example, some chiller plants still need to operate during night time; some water heating equipment still need to inject energy to maintain the water temperature; some emergency lighting are needed to operate on a 24-hour basis etc. These “must use” loadings can be focused and hence tailor-made energy saving solutions can be developed for these equipments. As this ‘base load’ is constant and predictable, it is therefore possible to apply small scales energy efficient techniques for the equipment to operate at the most efficient settings for saving maximization. By adopting this approach, although the capital investment may be small, the achieved saving could be significant.

One other important consideration in

carrying out energy efficiency project is its expandability or extendibility. The need for future expansion must be taken into account during the design phase. After the first small scale applications of the energy saving equipment, it is important to allow for possible future extension. For example, one can choose some control system with open protocol for easy modifications. Additional new control points must be capable of being added later with simple programming works to expand the control network. Wireless technologies such as WiFi, Zigbee could be good solutions to reduce the cabling costs during network extension or retrofit to existing equipment where cabling cannot be effectively carried out.

The HKSAR Government has launched the 'Energy Conservation Funding' scheme this April to promote energy saving. Building owners can make good use of this Fund to facilitate their energy saving projects.

5. CONCLUSION

With the help of the Government and the different learning societies (like HKIE) in promoting energy and carbon audits, the general public now knows more and more where their energy and money goes. People start to realize that there are many means to help to reduce energy and hence their operating expenses. Many companies are also aware of the carbon emission and develop plans to reduce their carbon emission. The green technologies that described in this paper can help to reduce carbon emission and it is not far from our dream to significantly reduce carbon emission. The 'base load' approach can address some of the issue with insufficient investment to replace old equipment. On the other hand, these green technologies can help to trigger behaviour change and form the green culture to sustain our future.

REFERENCES

- [1] The HKSAR Environmental Protection Department and Electrical and Mechanical Department (2007), "Guidelines to Energy Audit"
- [2] The HKSAR Environmental Protection Department and Electrical and Mechanical Department (2008, July), "Guidelines to Account for and Report on Greenhouse Gas Emissions and Removals for Buildings (Commercial, Residential or Institutional Purposes) in Hong Kong."
- [3] Kistler, Paul (2006, August), "Oil Free Magnetic Bearing Chiller Compressor".
- [4] Barney, Gina (2009, July), "Elevating Efficiency", CIBSE Journal
- [5] Shi, Lin (2007, June), "High Temperature Heat Pump Technology - Development and Application", CLP Power Heat Pump Seminar 2007.
- [6] Ngan, C.C. (2007, June), "Trial of Solar Boosted Heat Pump in Hong Kong", CLP Power Heat Pump Seminar 2007.
- [7] The HKSAR Architectural Services Department (2008, February), "Study of Green Roof Application in Hong Kong"
- [8] Cheng, K.W. Eric (2009, May), "Recent Development on Electric Vehicles", 2009 3rd International Conference on Power Electronics Systems and Applications.

**STATE-OF-THE-ART BATTERIES FOR ELECTRIC VEHICLE
AND INDUSTRIAL APPLICATIONS**

Paper No. 3

**Speaker : Mr Kevin K.M. Yiu
Business Development Director
EVB Technology (HK) Limited**

STATE-OF-THE-ART BATTERIES FOR ELECTRIC VEHICLE AND INDUSTRIAL APPLICATIONS

Mr Kevin K.M. Yiu
Business Development Director
EVB Technology (HK) Limited

ABSTRACT

Electric vehicles have been around since the introduction of automobile. For many years, lead-acid batteries had been the choice due to availability, technology and cost. Since 1990 the industry began seeking advanced battery solutions to satisfy the market needs for a compact, reliable, powerful and light-weight alternative to traditional flooded lead-acid batteries. During this time, Gold Peak began investigating various battery technologies, and decided to develop heavy-duty prismatic batteries for electric vehicle and industrial applications. In 1993, with a NiMH licensing agreement from Ovonic/ECD, we began manufacturing our first Nickel Metal Hydride (NiMH) batteries for electric vehicles.

Gold Peak (GP Batteries) manufactures a wide range of battery cells and battery systems for many consumer and industrial applications. Our product range includes small consumer type batteries in various chemistries and sizes; from small primary silver-oxide button cells to primary lithium, alkaline and carbon zinc cylindrical and 9V cells. Our rechargeable battery cells include button, cylindrical, polymer and prismatic formats in the following chemistries: NiMH, Lithium Cobalt, Lithium Manganese, and Lithium Iron Phosphate. We have significant experience in manufacturing many popular chemistries, and EVB Technology (a member of the Gold Peak Group) chose to design and manufacture prismatic format NiMH and Lithium Iron Phosphate chemistries for the electric vehicle industry. Based on our extensive experience and data in manufacturing large quantities of smaller cells, we are here to present our findings and reasons for selecting Ni-MH and Lithium Iron Phosphate as our preferred choice for electric vehicle and industrial applications, and a comparison of different chemistries.

1. NICKEL METAL HYDRIDE BATTERIES (NiMH)

It is the most popular choice of chemistry for


almost every mass-produced vehicle from major automobile manufacturers. Although the NiMH license required for manufacturing limits the technology rights to an exclusive group of reputable battery manufacturers, the performance, reliability, robustness, safety and power of this chemistry make it the most common chemistry used in hybrid and electric vehicles today.

The advantages of NiMH for electric vehicle and industrial applications include:

1. Long cycle life and calendar life, long storage life, wide range of operating temperatures.
2. Ability to have high regeneration charge acceptance.
3. Proven safety and reliability record on over 2 million HEVs worldwide *
4. Low cost, simple monitoring and cell balancing.
5. Recyclable and life of car performance.
6. Robust enough for more than 10 years service life.

Please reference the following performance curves for our Ni-MH batteries used in electric vehicle and industrial applications:

Figure 1 Constant Current Charging Characteristic of 10/MQ90EVH at Positive and Negative Temperature Cut-off by -dV of (0.1/Module)

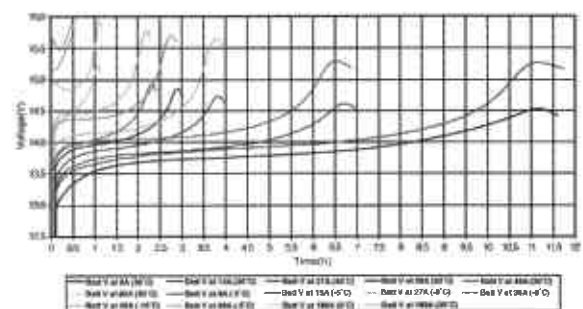

Paper No. 3

Figure 2 Constant Current Discharge Characteristic of 10/MQ90EVH at Positive and Negative Temperature Cut-off by Vdco of (10V/Module)

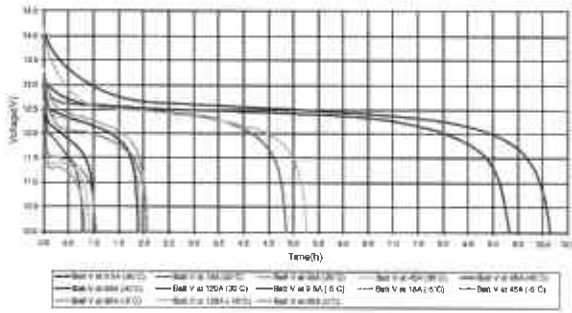


Figure 3 Storage Characteristics


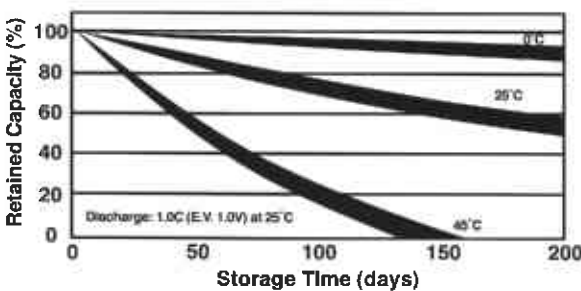


Figure 4 Charge Retention Test

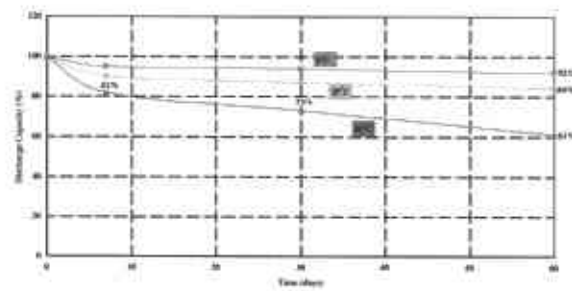

2. LITHIUM IRON PHOSPHATE (LIFEPO4)

Lithium Iron Phosphate is one of the most sensible choices among Lithium based chemistries. As the pursuit of higher energy density batteries for the electric vehicle market continued, EVB Technology responded by



introducing our prismatic Lithium Ion type Lithium Iron Phosphate batteries in 2008. It is very likely that Lithium Iron Phosphate will be the choice of tomorrow and the results of our in-house testing indicate excellent performance characteristics. However, Lithium Iron Phosphate still lacks the track record in real applications necessary to prove its road worthiness.



The advantages of Lithium Iron Phosphate for electric vehicle and industrial applications include:

1. High cycle life and calendar life (accelerated test)
2. High C-rate charge and discharge capability
3. Charge and discharge abuse tolerance (compared to other Lithium based chemistries)
4. Wide operating temperature range.
5. Stable raw material cost

Please see the following performance curves of our LiFePO₄ Batteries:

Figure 5 Performance Curves of LiFePO₄ Batteries

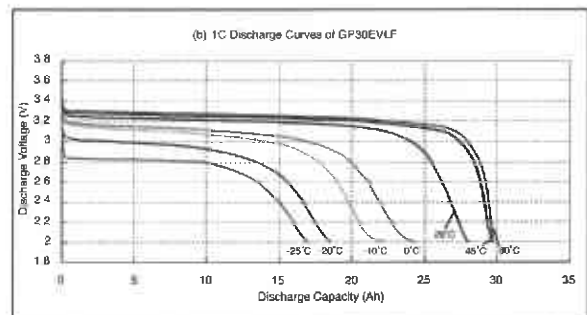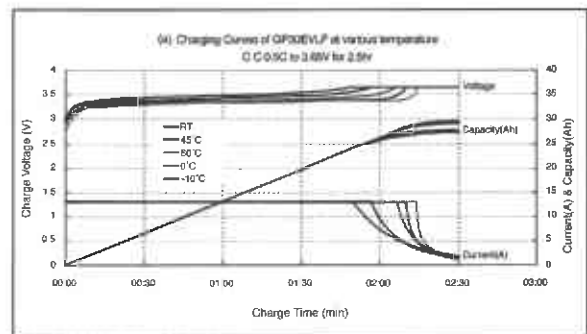

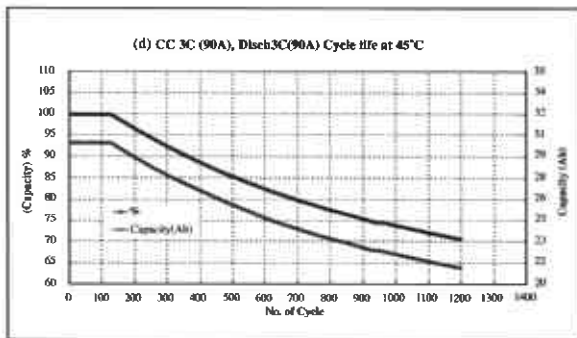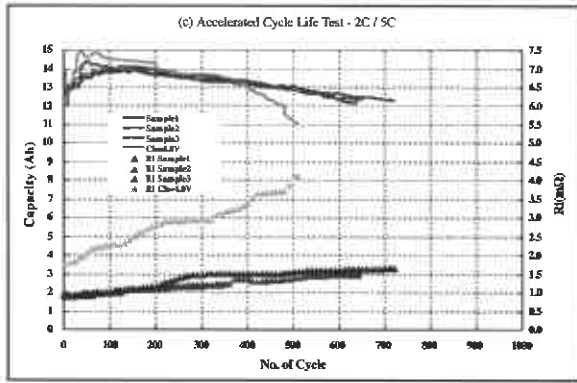

3. CONCLUSION

In Summary, EVB Technology's position on the practical choice of batteries for electric vehicle and industrial applications:

NiMH is the most practical choice for batteries in electric vehicle and industrial applications today, and Lithium Iron Phosphate will be our focus for future development and applications.

Paper No. 4

**ENHANCED SYSTEM RELIABILITY –
PERSPECTIVE FROM DISTRIBUTION CABLE/MATERIALS**

**Speaker : Dr Peter K. Pang
End-Use Marketing Manager
Dow Wire & Cable
Dow Chemical (China) Investment Co. Ltd.**

ENHANCED SYSTEM RELIABILITY – PERSPECTIVE FROM DISTRIBUTION CABLE/MATERIALS

Dr Peter K. Pang
End-Use Marketing Manager
Dow Wire & Cable
Dow Chemical (China) Investment Co. Ltd.

ABSTRACT

With ever increasing demand for improving transmission and distribution system reliability and rising cost for infrastructure needed to ensure uninterrupted electricity supply to critical customers, increasing expectations are being put on performance of cable materials that can provide significantly longer life. Such materials with increasing life expectancy can provide positive returns based on life cycle cost analysis. The key variables affecting cable life are described and the 25-plus years of field performance on cables provided by tree-retardant crosslinkable polyethylene insulation materials are illustrated with actual field performance data. In addition to continuously improve the quality of cable materials to ensure their integrity in positively impacting cable life, some ideas about future development for next generation materials to meet the continuous demand from electrical utilities for lower system cost with good reliability are discussed.

1. INTRODUCTION

Electrical utility companies are striving to reduce the life cycle cost of their transmission and distribution systems in response to economic and environmental drives. The use of tree retardant crosslinked polyethylene (TR-XLPE) insulation for medium voltage (MV) and very clean insulation for high (HV) and extra-high voltage (EHV) cables has allowed utilities to achieve long service life under severe operating conditions. This has led to

improved life cycle economics and minimized social and environmental issues resulting from cable replacement activities.

In this paper an overview of the current state-of-the-art material technology for MV and HV cables will be presented, then followed by discussion on the possibility of future material technology development that can either provide better performance-cost ratio or further enhance cable connectivity.

2. CURRENT STATE-OF-THE-ART TECHNOLOGY


2.1 GLOBAL EXPERIENCE WITH TR-XLPE INSULATION

In addition to significantly retard the growth of water trees, TR-XLPE was designed to maintain the high dielectric strength and low electrical loss of XLPE materials. It was introduced in 1983 and in the following 26 years, TR-XLPE has become the predominant insulation used for MV underground distribution cables in North America.

Recent studies from field aged cables have clearly demonstrated that TR-XLPE shows the highest level of dielectric strength after 17 years of field aging^[1], as shown in Figure 1. Over the past 24 years, the demonstrated performance of TR-XLPE insulated cables has met the initial design expectations such that projections are being made for TR-XLPE cables to have useful life in excess of 40 years^[2].

Paper
No. 4

Figure 1 Dielectric Strength of Field Aged 35kV Cables

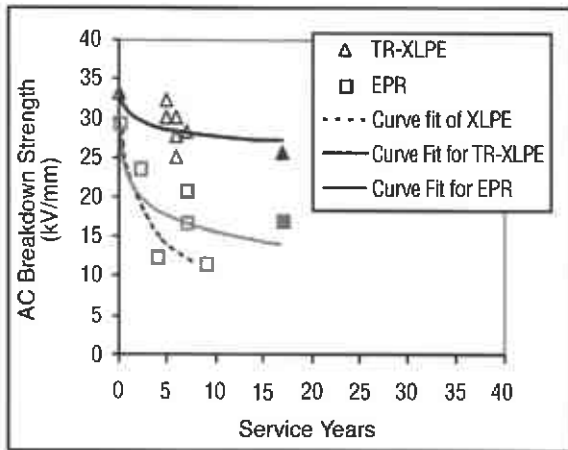

In Europe, an approach being different than that in North America is used to prolong cable life. Researchers found that blends of polyethylene resin used in XLPE with copolymers, based on alkyl acrylate copolymers, resulted in improved resistance to electrical breakdown after aging in water under electrical stress. This technology has also had excellent field service performance for MV cables.

Historically in Asia, there was little emphasis on the long term performance of MV cables such that there were no performance specifications to ensure long life cables. As the performance results of TR-XLPE insulations being used in North America and Europe have been consistently demonstrated, several Asian countries began adopting performance specifications for their cables. For example, in the Philippines, South Korea, Australia, and New Zealand, TR-XLPE cables have been used since 1990's.

In China, electric utilities are beginning to focus on improving the life and reliability of MV cables. In order to access the performance improvement with TR-XLPE insulation for the PRC utilities, a major cable compound manufacturer and Wuhan High Voltage Research Institute jointly developed a cable testing programme, using accelerated water tree test (AWTT) as stipulated in ICEA S-94-649-2004 specifications. Results from this

cable aging test programme clearly demonstrated the performance superiority of TR-XLPE cables and this had led to the establishment of industrial specifications DL/T 1070-2007 (Qualification test methods and requirements for tree retardant performance of medium voltage XLPE power cables). The latter stipulates the qualification test method and performance requirements for TR-XLPE power cables, in terms of retained AC breakdown (ACBD) strength after aging. The requirements of retained ACBD are summarized in Table 1 for DL/T 1070-2007 and ICEA S-94-649-2004 specifications. Apparently, DL/T 1070-2007 specification has demanded a higher retention of ACBD than ICEA S-94-649 after 360 days of aging.

Table 1 RETAINED ACBD for TR-XLPE INSULATION

(kV/mm)	14d Cyclic	After 120d	After 180d	After 360d
DL/T 1070-2007	26.0	26.0	22.8	20.0
ICEAS-94-649-2004	26.0	26.0	22.8	15.0

In Latin America, TR-XLPE has been used in Brazil, Chile, Columbia, and Mexico. In Mexico, TR-XLPE is also specified as one of the materials of choice for HV cables up to 132kV. As typical HV cables have built-in moisture barriers, apparently TR-XLPE is being considered as an additional insurance for potential water treeing due to water ingress that could be resulted from damaged moisture barriers.

In India and the Middle East regions, several utilities have incorporated TR-XLPE into their performance specifications for MV cables. In India, TR-XLPE is also specified for 66kV HV cables.

2.2 HIGH VOLTAGE INSULATION

HV and EHV cable usage is growing around the world, especially in urban areas. With the advent of ultra high voltage transmission from east to west in China, more HV cables of 220kV and above are being used to upgrade the transmission grids.

HV and EHV cables are produced with constructions that are intended to keep them dry radially and longitudinally. Hence, electrical aging of and tree formation within the insulation are the most important properties for determining the life of cables. Two key factors in the electrical tree retardance of insulation are the insulation cleanliness and the smoothness of the insulation-conductor semi-conductive shield interface^[3].

Two of the key requirements for high voltage and extra- high voltage XLPE insulation under IEC 60840 and IEC 62067 norms respectively are summarized in Table 2.

Critical to the performance of XLPE insulation operating under high electrical stresses is the cleanliness of the insulation and the need for very low dissipation factor values. Cleanliness of the insulation is ensured by precise control and monitoring of the manufacturing process and subsequent compounding, packaging and logistic operations. XLPE insulation compounds should be free of metal contamination and particles greater than 100µm.

Customer specifications are even more stringent for EHV insulation materials. To ensure that the insulation compound cleanliness is maintained from compound manufacturing centre to cable production, one of the major cable compound manufacturers has developed a multi-liner bulk carton system which helps to preserve material cleanliness. Using this system, the cable manufacturer can remove the outer cardboard packaging before the material enters the cable production area. The inner liner design ensures that the insulation material remains in a closed system from initial production through to cable extrusion, thus minimizing the possibility of external contamination.

TABLE 2 KEY REQUIREMENTS for HV/ EHV INSULATION

	High Voltage	Extra High Voltage
Key Standards	IEC 60840	IEC 62067 AEIC CS9 TEPCO
Cleanliness	100µm Clean	70µm Clean
Dissipation F. (U ₀ ,100°C)	< 0.1%	< 0.05% customer requirements

As the operating voltage increases, the dielectric power loss also increases. Tan delta is a measure of the degree of power dissipation in a dielectric and therefore a measure of its losses. For power cables, the tan delta value of the insulation should be as low as possible to minimize the power loss. This is particularly true for HV transmission cables in which the dielectric loss component becomes a significant portion of the overall losses in the cable.

In fact the dissipation factor or tan δ is highly sensitive to polar impurities in the XLPE insulation material and minute quantities of contamination can have a drastic effect on tan delta. As shown in Table 2, IEC 60840 requires that the cable dissipation factor be less than 0.001 or 0.1%.

Paper No. 4

Figure 2 Dissipation Factor Improvement with Super Clean Compound

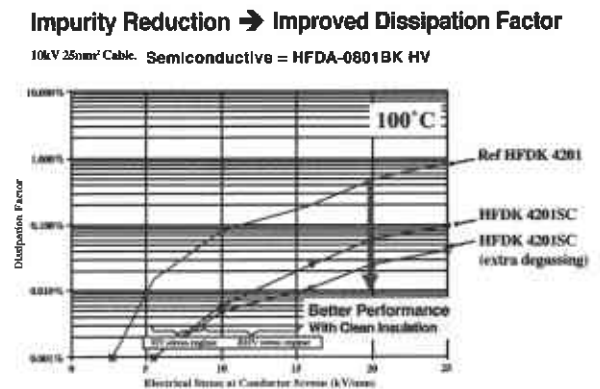


Figure 2 shows the dissipation factor measurements on model medium voltage cables using conventional and super clean insulation compounds at 100°C as a function of electrical stress level. The conventional compound is an insulation compound designed for MV cables. The super clean compound is an insulation compound designed for HV and EHV cables. The data in Figure 2 clearly illustrates the importance of insulation cleanliness on its dissipation factor value.

The presence of polar residues from peroxide decomposition can have a negative impact on tan delta values and therefore cable performance.

Illustrated in Figure 2 is the effect of an

improved degassing regime on cable tan delta performance.

Of course insulation cleanliness and dissipation factor are not the only requirements for high performance insulation materials. Additives used to ensure long term heat ageing performance must not migrate out of the polymer pellets during transportation or storage at the customer. Some HV cable polymers incorporate a migration resistant additive package allowing long term storage even at high temperatures. The correct balance of stabilizers and peroxide curatives must also be determined to help ensure, not only long term ageing performance, but also scorch resistance and minimization of amber or gel formation during long production runs.

2.3 SEMI-CONDUCTOR SHIELDS


A very important development in raising cable quality and performance levels has been the improvement in the semi-conductor shield properties^[3]. In MV and HV power cables an inner (conductor) and outer (insulation) semi-conductive layers are needed to smooth and equalize the strong electrical field in the cable. This semi-conductive compound is typically a carbon black filled polymer having between a 30-40% carbon black addition levels. The inner semi-conductor layer is always cross-linked and “fully bonded” to the insulation. It must also have low impurity levels and yield both a very smooth interface with the insulation layer. The smoothness at the interface between the insulation layer and semi-conductive shields is very important to the long term electrical performance of power cables. Micro-protrusions from the semi-conductive shields can result in localized electrical stresses and induce undesired treeing or electrical degradation. Typical sources of the protrusions are grit from carbon black, poor dispersion of carbon black, polymer gels, or external contamination.

For HV cables, semi-conductive materials based on acetylene carbon blacks, referred to as

“supersmooth”, are generally used.

Figure 3 shows the reduction in cable dissipation factor achieved by replacing conventional semi-conductive materials as both inner and outer semi-con in a model medium voltage cable.

Figure 3 Dissipation Factor Reduction when Replacing a Conventional Semi-Con by Super Smooth Semi-Con in a Medium Voltage Model Cable

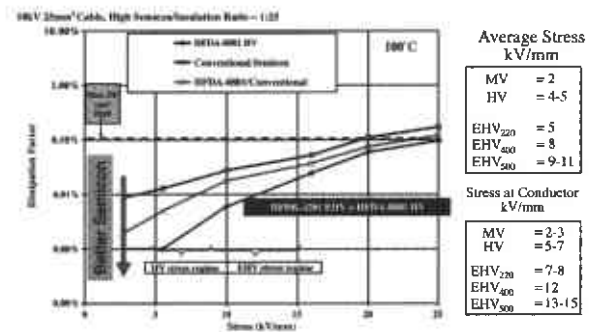


3. FUTURE TECHNOLOGY TRENDS

3.1 IMPROVE WATER TREE RESISTANCE OF HV CABLES

For HV cables, moisture barriers, like water swellable tapes and metallic sheaths, are present to prevent the ingress of moisture during cable installation and subsequent operation. Although, such moisture barriers can be damaged during cable installation and can subsequently lead to water ingress and cable failures. TR-XLPE insulation can be considered as an additional means of insurance against water treeing in HV cables.


Due to higher operating stress in HV cables, the resistance of electrical treeing of an insulation material should be considered. As shown in Figure 4^[4], the electroluminescence of TR-XLPE material shows comparable performance to that of XLPE as a function of inception voltage.

Figure 4 Electroluminescence of XLPE and TR-XLPE materials

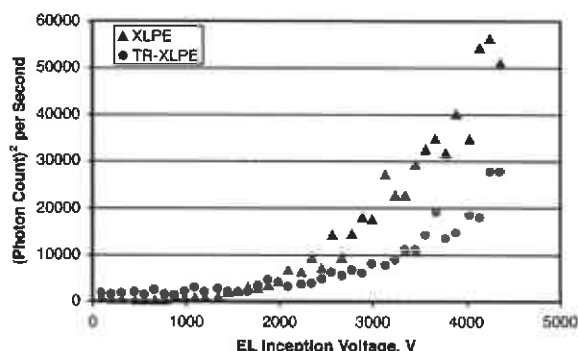

Due to the chemical nature of TR-XLPE compounds, their dissipation factor is usually slightly higher than that of XLPE compounds at operating temperatures. Thus, it is imperative to understand the dissipation factor of TR-XLPE material at higher operating electrical stresses, to ensure there will not be any adverse effect at operating voltages of HV cables. A model cable made with a 24mm² aluminium conductor and 3mm insulation was tested for dissipation at different operating stresses^[5]. As shown in Figure 5, the dissipation factor of TR-XLPE at 100°C increases with increasing stress. In order to meet the dissipation factor requirement of less than 0.1%, as specified in AEIC CS9-06, ICEA S-108-720-2004, and IEC 60840 specifications, TR-XLPE material can be used up to a stress level of 7kV/mm. Typical maximum stress for a 138kV cable is 7 - 8 kV/mm.

Figure 5 Dissipation Factor at 100°C for a Model Cable Comparing XLPE and TR-XLPE Materials Operating at Increasing Stress Levels

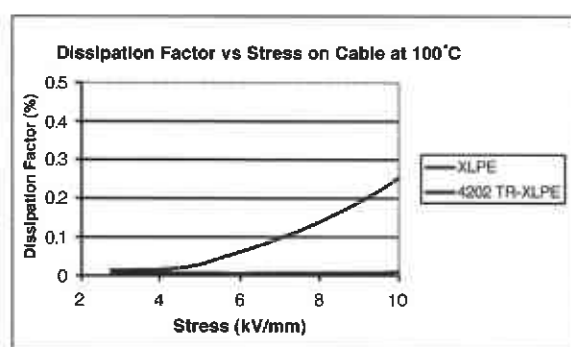

The retained ACBD strength of cables made

with TR-XLPE was also evaluated at higher electrical stress during wet aging (AWTT) study by varying the insulation thickness. Model cables made with 53mm² aluminium conductor and insulation thicknesses of 2.7 and 4.4mm were tested under AWTT condition. As shown in Table 3^[5], TR-XLPE demonstrates excellent dielectric strength after wet aging at high stress vs. XLPE materials.

TABLE 3 RETAINED ACBD FOR TR-XLPE INSULATION AT HIGH STRESS

Insulation Thickness (mm)	Average Electrical Stress During Aging (kV/mm)	Maximum Electrical Stress During Aging (kV/mm)	AC Breakdown Stress (kV/mm)		
			TR-XLPE		XLPE
			Unaged	Aged-120d	Aged-120d
4.4	5.6	8.1	58	38	19-
			56	34	25
			59	33	
2.7	9.8	12.1	54	37	
			41	34	
			54	34	

Paper No. 4

Today, only a 115kV HV cable made with TR-XLPE has been in use in Mexico. Given the very limited usage of TR-XLPE materials for HV cables, more full-size cable data should be generated and evaluated before adopting the technology for wider commercial use.

3.2 INCREASE DIELECTRIC STRENGTH OF XLPE MATERIALS

The perceived benefits of increasing the dielectric strength of XLPE are mainly in reducing insulation thickness and overall cable diameter. This would allow installation of smaller diameter cables through existing constrained underground conduits.

Another way to take advantage of increased dielectric strength is to achieve lower distribution loss by operating cables at higher voltages. For example, the State Grid in China has decided to increase operating voltage from 10kV to 20kV in some local cities, to reduce investment cost^[6]. Using cables that were originally designed for 10kV and operate them at 20kV will subject insulation materials to a higher electrical stress and decrease their expected life. Thus, insulation materials with better dielectric strength will be needed for such an application.

Power loss can also be reduced by using cables with a larger conductor, while retaining the same overall cable diameter. However, this will require additional capital investment, as cost of conductor accounts for the majority material cost of cables.

Nanocomposite dielectrics is being evaluated to increase the dielectric strength of XLPE, in which nano filler materials are incorporated into regular dielectrics like XLPE. In the laboratory, XLPE materials containing vinylsilane-treated silica have exhibited longer time-to-failure and higher breakdown strength^[7]. Nanocomposite dielectrics made of MgO and low density polyethylene have also been shown to have superior thermal breakdown performance in HVDC application^[8].

Despite some of these successes demonstrated in the laboratory, nanocomposite dielectrics are not yet available commercially. One of the key reasons is that the incorporation and dispersion of nano fillers into XLPE is not easily attained in commercial scale mixing equipment. Without proper dispersion of these nano fillers, large aggregates of these particulates can actually cause localized dielectric failures^[9]. In addition, the long-term stability of these nanocomposite dielectrics under field aging has not been evaluated and needs to be understood before field application can be proliferated.

3.3 INCREASE ELECTRICAL TREE RESISTANCE OF XLPE MATERIALS

Similar to increasing the dielectric strength of XLPE, the key benefits of improving the resistance to electrical treeing of XLPE insulation are increasing the longevity and economical value of HV and EHV cables, where the insulation materials are subjected to higher electrical stresses.

Electrical treeing processes are divided into three stages: inception, growth, and breakdown of insulation materials^[10]. Given the importance of the inception phase of electrical treeing, studies have been conducted to find additives that could inhibit tree inception. As shown in Table 4^[11], using ASTM D3756

double-needle test, polymers with aromatic structures on their backbone, such as polysulfone, polyethylene terephthalate, and polycarbonate, have much higher characteristic voltage (or resistance to electrical treeing) than polyethylene.

TABLE 4 DOUBLE-NEEDLE TEST CHARACTERISTIC VOLTAGE for POLYMERIC INSULATION MATERIALS^[12]

Material	Characteristic Voltage (kV)
Polysulfone	27
Polyethylene terephthalate	25
Polycarbonate	19
XLPE	18
Polystyrene	12.5

This led to the idea of incorporating additives called voltage stabilizers into XLPE materials that were considered to be capable of absorbing energetic electrons and thereby preventing the occurrence of electron avalanches that lead to dielectric failure of polyethylene insulation^[12]. Voltage stabilizers are additives that have: (1) at least one electron acceptor group, an unsaturated radical containing a π bond such as $-\text{NO}_2$, $-\text{CN}$, $=\text{CO}$, benzyl group, or a polycyclic aromatic; (2) an electron donor group, such as amino and lower alkyl radicals which contain a transferable proton such as $-\text{N}(\text{CH}_3)_2$, $-\text{NH}_2$, and $-\text{CH}_3$; (3) potential hydrogen bonding between the acceptor and donor group by a transferable proton, as when they are ortho on a benzene ring; (4) reversibility of the proton transfer between groups; (5) an aromatic ring structure to facilitate transfer of charge between substituent groups; (6) adequate size and complexity of the aromatic rings system to provide for electron capture and subsequent energy dissipation without producing bond rupture; (7) adequate solubility of the additive in polyethylene.

Recent study^[13] using quantum mechanics has identified electron affinities and ionisation potentials as fundamental properties of voltage stabilizers to inhibit electrical tree inception. This study concluded that voltage stabilizers are molecules that have high adiabatic electron

affinity and low ionization potential. Molecules with high electron affinity will easily accept space charge electrons. And molecules with low ionization potential will form ions more easily with injected space charge.

Numerous additives have been demonstrated in the laboratory to increase the breakdown voltage of XLPE materials^[14]. However, due to the limited solubility of these types of additives in polyethylene and their long-term stability under actual field aging conditions, commercial use of voltage stabilizers have not been prevalent.

3.4 SELF-HEALING CABLE MATERIALS.

Many of the damages to direct-burial cables occur during installation as a result of accidental dig-in. These kinds of damages often lead to moisture ingress that can subsequently cause cable failures. The concept of self-healing cables which discusses cables with self-healing capability to mitigate damages caused by accidental dig-in has been in the patent literatures. Many of these have discussed the use of water swellable agents either in the jacket or insulation materials^{[15], [16]} that react with ingressed moisture to form a sealant for the damaged areas.

Another concept that has surfaced recently is the use of compressible/expandable foam that can seal the damaged cable once breach of the jacket has occurred^[15].

Although self-healing concept has been promoted for many years, but it has not been practiced commercially for many reasons. Among which are: (1) Compatibility of self-healing agents with cable materials, as many of which being proposed were incompatible with polyolefinic materials. (2) Effectiveness of self-healing agents, as the chemical reaction between the agents and ingressed water may not be fast enough to capture all the ingressed water. (3) Long-term effectiveness of self-healing agents. Some of the proposed methods of incorporating self-healing agents include use of micro-encapsulated agents in the insulation

materials. Potency of these agents may be reduced over time as diffusion out of the encapsulant may occur.

4. REFERENCES

- [1] A. Mendelsohn, T.J. Person, G.B. Shattuck, R. Hartlein, "Evaluation of tree retardant XLPE (TR-XLPE) and EPR insulated 35kV cables after 17 years of field service", Jicable 03, Versailles, France, pp. 556-561.
- [2] EPRI Distribution Cable Research Digest 2000, Publication BR-110693, 1998 (available to EPRI members only).
- [3] N. Burns, R.M. Eichhorn, C. Reid, IEEE Electrical Insulation Magazine, Vol. 8, Issue 5, p. 8-24, 1992.
- [4] S.J. Han and L.H. Gross, IEEE international Symposium on Electrical Insulation, Indianapolis, 2004, pp. 523-526.
- [5] P.J. Caronia, S.J. Han, J.B. Kjellqvist, and T.J. Person, "Exploring Dow 4202 TR-XLPE insulation for high voltage cables", Wire 2008, Dusseldorf.
- [6] X. Yang, "Distribution medium voltage level optimization and pilot study", 2008 China International Conference on Electricity Distribution (CICED 2008), 10-13, Dec. 2008, Guangzhou, China.
- [7] M. Roy, J.K. Nelson, R.K. MacCrone, L.S. Schadler, C.W. Reed, R. Keefe, Dielectrics and Electrical Insulation, IEEE Transactions on Volume 12, Issue 4, Aug. 2005, pp. 629 - 643.
- [8] C.C. Reddy, M. Gosyowaki, Y. Murata, Y. Sekiguchi, Electrical Insulating Materials, 2008. (ISEIM 2008). International Symposium on, 7-11 Sept. 2008, pp. 661 - 664.
- [9] S. Singha and M. Joy Thomas, "Polymer composite/ nanocomposite processing and its effects on the electrical properties", in 2006 Ann. Rep. Conf. Electrical Insulation and Dielectric Phenomena (CEIDP), pp. 557-560.
- [10] L.A. Dissado and J.C. Fothergill, "Electrical degradation breakdown in polymer", London: Peter Peregrinus Ltd., 1992.

- [11] R.M. Eichhorn, “Treeing in solid organic dielectrics”, Ch. 4, Engineering Dielectrics Vol. IIA, pp. 355-444.
- [12] A. Ashcraft, R.M. Eichhorn, and R.G. Shaw, 1976 IEEE International Symposium on Electrical Insulations, Conference Record 76CH1088-4-E1, Montreal Canada, 14-16 June 1976, pp. 213-218.
- [13] S. Kisin, J.D. Doelder, R.F. Eaton, and P.J. Caronia, “Quantum mechanical criteria for choosing appropriate voltage stabilization additives for polyethylene”, Polymer Degradation and Stability, Vol. 94(3), pp.171-175, 2009.
- [14] V. Englund, T. Hjertberg, S. Gubanski, and R. Huuva, “Voltage stabilizers for improving the electrical treeing resistance of XLPE”, Proceedings of 2008 International Symposium on Electrical Insulating Materials, 7-11 Sept., 2008, Yokkaichi, Mei, Japan, pp. 566-569.
- [15] F. Marciano-Agostinelli, M. Barbaro-Forlei, C. Marin, and P. L. Cinquemani, “Power cable with water swellable agents and elongated metal elements outside cable insulation”, US patent 5010209, Apr. 23, 1991.
- [16] D. Reece, J. Walker, N. Ware, and P. Sasse, “Electrical cable having a self-sealing agent and method for preventing water from contacting the conductor”, US patent 6184473, Feb. 6, 2001.
- [17] D. R. Huston and B. R. Tolmie, “Self-healing cable for extreme environments”, US patent 7569774B2, Aug. 4, 2009.

Paper No. 5

**CONTEMPORARY DESIGN OF ELECTRICAL AND
VERTICAL TRANSPORTATION SYSTEMS FOR SUPER
HIGH-RISE BUILDINGS IN MAINLAND CHINA AND HONG KONG**

**Speakers : Ir H.K. Yung, Director
Ir Tony C.F. Lau, Associate Director
Ir Tony C.W. Leung, Associate
J. Roger Preston Ltd., Hong Kong**

CONTEMPORARY DESIGN OF ELECTRICAL AND VERTICAL TRANSPORTATION SYSTEMS FOR SUPER HIGH-RISE BUILDINGS IN MAINLAND CHINA AND HONG KONG

Ir H.K. Yung, Director
Ir Tony C.F. Lau, Associate Director
Ir Tony C.W. Leung, Associate
J. Roger Preston Ltd., Hong Kong

ABSTRACT

In the recent decade, the developments of skyscrapers have been growing significantly in the metropolitan cities of Mainland China such as Tianjin, Shanghai and Shenzhen. The heights of the skyscrapers hit new record all over the world.

As a special region of Mainland China, Hong Kong is a pioneer in the development of super high-rise buildings. The recent representatives are 2IFC and ICC which are skyscrapers of more than 400m in height. Engineers of Hong Kong are fully conversant with the design of electrical and vertical transportation systems which best suit the needs of super high-rise buildings. However, the rules, regulations and practices in Mainland China and Hong Kong are mostly different though the design concepts have a lot in common. This paper outlines the design of electrical and vertical transportation systems for projects in Mainland China and Hong Kong, along with special considerations on system design from perspectives on supply voltage level selection, equipment rating determination, delivery strategy etc.

1. INTRODUCTION

With the economic boom in Mainland China, modern skyscrapers have changed the urban landscape of the metropolitan cities in the last decade. Most of the leading consulting firms in Hong Kong nowadays are taking part in the MEP design of super high-rise building projects in Mainland China which demand designs with cutting-edge technologies and compliance with rules and regulations in Mainland China. These all-embracing designs pose formidable challenge to all engineers in Hong Kong.

2. MAIN ELECTRICAL SYSTEM

2.1 ELECTRICITY SUPPLY

Technical and financial considerations are important factors in determining the supply voltage level and the configuration of substations in the development for projects in Mainland China.

While the supply voltage levels in Hong Kong range from 380V to 11kV and the substations are designed according to the requirements of HEC/CLP, the supply voltage levels in Mainland China range from 380V to 220kV. 380V is classified as low voltage, 10kV and 35kV are classified as middle voltage and 110kV and 220kV as high voltage. The supply voltages vary from provinces to provinces. 10kV and 35kV are popular in cities of northern provinces, e.g. Shanghai and Tianjin whereas 10kV and 110kV are popular in cities of southern provinces, e.g. Shenzhen.

Besides, power bureaus in various cities/provinces may have their own rules to determine the level of supply voltage and the requirements of substations in the development. In general, 10kV power supply substations is required for transformer load not exceeding 8MVA and 35kV/110kV power supply substations are required for transformer load not exceeding 30~40MVA. The incoming power supplies usually come from underground power cable networks which are the mainstream of electricity distribution in metropolitan cities.

2.2 POWER TRANSFORMATION

Oil-filled, SF₆ and cast resin power

Paper
No. 5

transformers are commonly used in Mainland China. According to GB, oil-filled and SF₆ power transformers must be installed at either ground level or underground level whereas there is less constraint for cast resin power transformer application since cast resin power transformer is 'dry type' transformer which poses no leakage hazard and therefore, is commonly used in super high rise building. The drawbacks of cast resin transformers are, however, heavy weight and bulky size.

Unlike the practice of Hong Kong whereby the power transformers are usually provided by the power companies and the ratings of the transformers are usually 1000kVA, 1500kVA and 2000kVA, the power transformers of PRC projects are usually owned by the property developer, supplied and installed by power bureau recognized contractors and with ratings of 800kVA, 1000kVA, 1250kVA, 1600kVA, 2000kVA and 2500kVA which are readily available in commercial market of Mainland China.

When the transformers are installed at upper floors, equipment delivery is a concern. In Hong Kong, the common practice is to provide a dedicated 'Transformer' Lift to carry the heavy transformers or high voltage equipment according to CLP/HEC requirements. However, in Mainland China, lift shaft of service lift, as an alternative to transformer lift, is commonly adopted as a delivery route for transportation of transformers or heavy equipment. Therefore, the dimensions of the lift shaft of the service lift shall be large enough and installations inside the lift shaft shall be well coordinated to allow for free passage for transformer delivery.

2.3 POWER DISTRIBUTION

In super high-rise building, the length of power distribution risers will be very long which leads to voltage drop problems. Locating the power transformers as closely to the load centers as possible is the best way to contain voltage drop.

Super-high rise buildings in Hong Kong and Mainland China usually site the transformer rooms in above ground mechanical floors,

which are usually 25 storeys apart in Hong Kong and 15 storeys apart in Mainland China. Besides, transformer rooms can also be located in refuge floors for projects in Mainland China. This arrangement can limit the 'supply distance' of outgoing circuits within 150–200m such that the voltage drop across busducts/cable risers can be limited to reasonable values.

According to GB codes, an intelligent Electric Leakage Protective (ELP) system is required for Grade 1 buildings i.e. high-rise non-domestic buildings. It is realized by installing earth leakage current detection device for main circuits. For super high-rise buildings, the devices are usually addressable and installed at the outgoing circuits of the main electrical distribution risers. Whenever the measured earth leakage currents exceed the preset limit, the device will be activated and issue audio-visual alarms and/or initiates signals to trip the faulty circuitries.

2.4 CLASSIFICATION OF LOADS


The electrical loads of Hong Kong buildings are classified as non-essential loads, non-FSI essential loads and FSI essential loads, whereas the electrical loads of PRC buildings are classified as four types, namely most-important loads, Class 1 loads, Class 2 loads and Class 3 loads according to GB codes.

- Most important loads such as central control of security system, central clock system and building data storage system etc, require high reliability than the Class 1 loads as described in item 2 and shall be supplied with dual-feed circuits in different power sources as well as ready to be fed from standalone standby alternative power generation source, e.g. diesel generator set.
- Class 1 loads such as fire pumps, fireman's lift and emergency lighting etc shall be supplied with dual-feed circuits in different power source, e.g. two different substations.
- Class 2 loads such as air conditioning system and escalator etc shall be supplied with dual-feed from different circuits/

transformers, e.g. two different transformers in same substation.

- Class 3 loads such as general lighting and small power etc shall be supplied with single-feed circuit in single power source.

Figure 1 LV Schematic Diagram

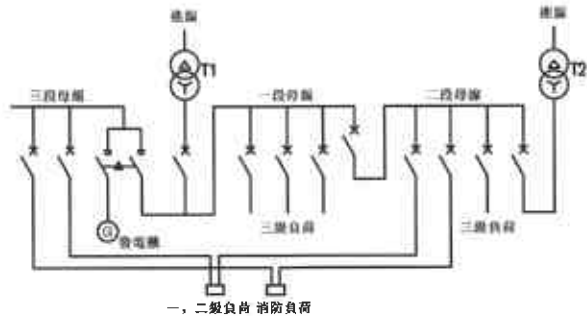

The following are options of secondary power supply which fulfill the different power source requirements as stipulated for the most important loads and the Class 1 loads: -

- One of dual-feed power supply from city power substation of Power Bureau;
- Diesel/gas generator set or cogen set.
- Solid-state power sustain unit. It can be interruptible or uninterruptible type. The former is named 'Emergency Power Supply (EPS)' e.g. self-contained rechargeable battery power pack for emergency lighting and the latter is named 'Uninterruptible Power Supply (UPS)' e.g. battery type UPS or fly-wheel type UPS for data equipment or production lines.

Figure 2 Self-contained Rechargeable Battery Power Pack



2.5 DIESEL GENSET SYSTEM

There are single-feed supply and dual-feed 'high reliability' power supply available from Power Grid in Mainland China. If the dual-feed power supply is not available in the vicinity of the development or not reliable enough to support the important loads, diesel genset will be an alternative. While Hong Kong regulations allow installation of gensets at high-level mechanical floors, GB codes however only allow installation of diesel gensets at ground floor or basement one.

For super high-rise buildings of height exceeding 300m, the length of the essential power cables will be very long when all the gensets are located at ground floor or basement one floor. Overcoming the heavy voltage drop will be the first challenge.


The second challenge will be the ventilation problem. Air is an essential element for proper operation of diesel gensets which need huge amount of air for engine combustion and heat removal. Sufficient louvers at the building facade and numerous air ducts are required to enable sufficient air entering and leaving the genset rooms at G/F or B1 floor.

The following strategies are usually adopted for skyscrapers in Mainland China to overcome the problems:-

i. Voltage Drop

As there is no way to re-site the gensets close to the loads, the possible solution is to apply a higher voltage to transmit essential power to loads at high levels. It can be realized by using high voltage (10kV) gensets and step down transformers. However, high voltage gensets are more expensive and will incur a higher maintenance cost. As an alternative, low voltage gensets complete with step up and step down transformers are usually adopted. The secondary of the step up transformer and the primary of the setup down transformer are usually connected in delta configuration in order to avoid the need of neutral conductors in the cable risers and to isolate the third order harmonics.

Figure 3 HV Schematic Diagram

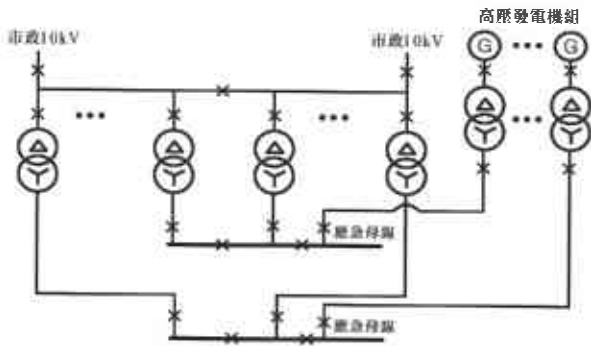

ii. Ventilation

Since the available space on ground floor or basement is usually limited and the size and location of intake and exhaust air ducts/duct shafts are often constrained by the site conditions, remote air-cooling or remote water-cooling in lieu of set mount cooling is often adopted to reduce the intake and exhaust ducts sizes and minimize the footprint required for the gensets room.

Figure 4 Remote Water-cooling


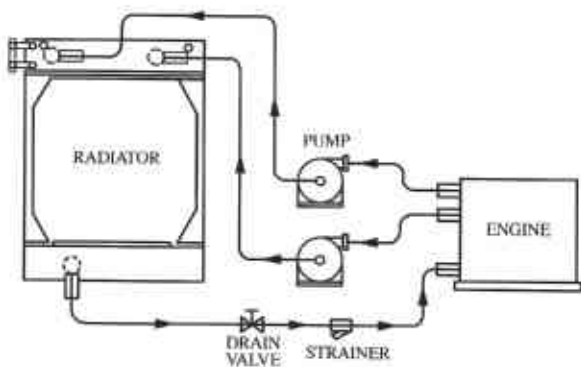


Figure 5 Remote Air-cooling

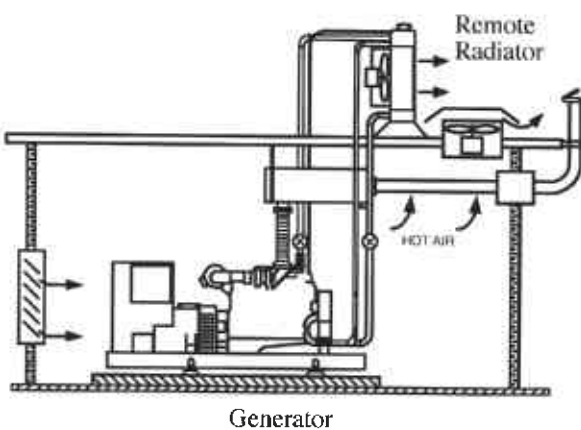


Remote water-cooling e.g. cooling tower can further minimize the plant room space since specific heat capacity of water is much higher than air. However, remote air-cooling e.g. remote radiator offers a more reliable way of ventilation and cooling as the risk of failure of pumps set and pipework for cooling tower is eliminated.

2.6 FUEL STORAGE AND FUEL RISERS

As gensets can be located on above ground mechanical floors in Hong Kong, daily tanks are also located on the mechanical floors to back up the gensets on the same mechanical floors. Bulk fuel tanks will be provided on ground floor for manual replenish of the daily tanks whenever required. Fuel pipe risers are also acceptable to the authorities when the installation can meet the stringent requirements as stipulated by FSD(DG).

In Mainland China, all the gensets can only be installed on ground floor or the first basement, no fuel pipe riser is needed and the daily tanks and the bulk fuel tanks are located on these two levels.

Figure 6 Fuel System Schematic Diagram

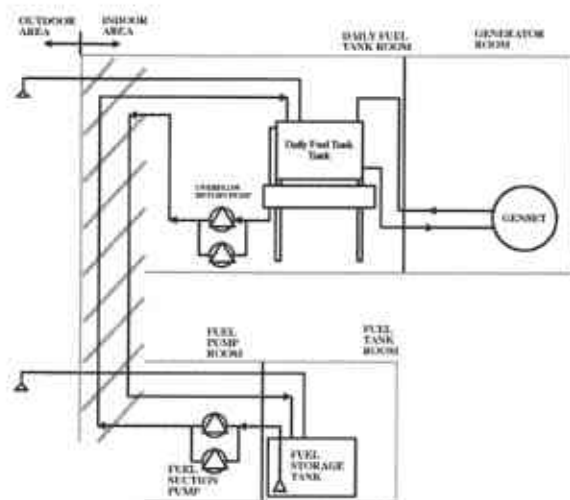

2.7 LIGHTNING PROTECTION

No doubt skyscrapers, whether located in Hong Kong or Mainland China, are prime targets for lightning strikes. On the roof of the skyscrapers, early streamer type lightning

arrestors are often adopted to offer lightning protection to the entire buildings. The arrestors will usually be connected to a number of dedicated re-bar down conductors embedded in structural columns evenly spread around the building perimeter and finally connected to the lightning earth pits/grids at the basement.

Along with the lightning protection by the early streamer arrestors, the curtain wall system will also be designed as an electrical continuous envelope and bonded to the re-bar to form a Faraday cage to protect the building from attack of side-flashing.

3. VERTICAL TRANSPORTATION SYSTEM


With a height of several hundred meters accommodating population of tens of thousand combined, flexible and expedient lift services play an important role in sustaining the operation of super-high rise buildings in good conditions. The following are the design approach to bring these about.

3.1 DESIGN APPROACH

SkyLobby Approach

Direct transportation between the main lift lobbies and all the local lift zones will be penalized for wasting a lot of lift shaft spaces and reducing the efficiency of the building core drastically. Sky-lobby approach, whereby low zone lifts and high zone lifts can share with each other the lift shaft spaces, is the best way to overcome such inefficiency.

Figure 7 Skylobby Approach

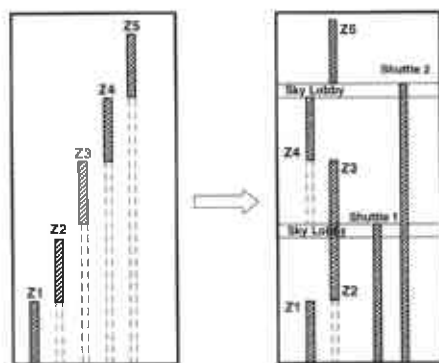

Double Deck Lift

When designing super high-rise buildings, double deck lift system combined with skylobby approach is often applied in order to further reduce floor space occupied by lift shafts. Also, double deck lifts are able to load/unload passengers on two consecutive floors simultaneously thus significantly increase the handling capacity of the lift services.

Destination Control


In order to achieve a smoother and more efficient way of handling passengers during peak and off-peak hours, destination control system is often adopted in super high-rise buildings.

Before getting in a lift car, passengers will register a call to the destination floors by either keying in the destination floor at the keypad or presenting a smartcard. Once a call is registered on the system, the control system will assign the most appropriate lift cars for the passengers. Combined with the function of grouping passengers destined for the same floors in the same lift cars, the handling capacity can be increased and the lifting performance will be optimized.

Crowd Control

Crowd sensor control function, which prevents passengers from crowding into lobby areas that have lifts of different capacities arriving and departing, is essential to lift installations incorporated with sky-lobby approach.

Figure 8 Crowd Sensor Control Schematic

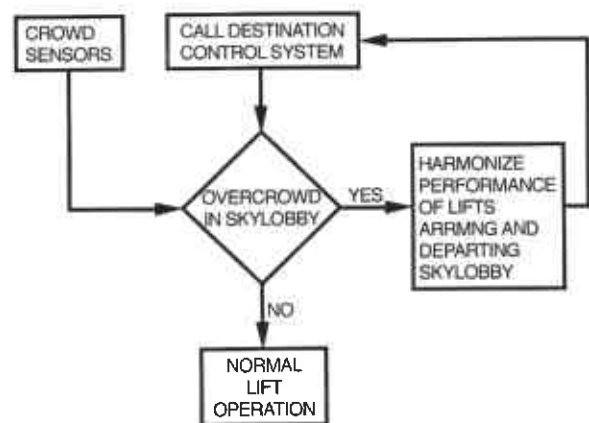

Paper No. 5

Under the crowd sensor control, passengers arriving and leaving the sky-lobbies can be closely monitored by the call destination control system and crowd detectors in lobbies. If there are more people arriving than people leaving, the departure trips will be prioritized compared to trips which bring people to sky-lobbies. Thus the transportation of passengers to the sky-lobbies will be reduced until the lobbies are no longer overcrowded.

Conquering Building Sway

Super high-rise buildings in tropical and subtropical areas e.g. Hong Kong and Southern regions of Mainland China will be subject to strong wind effects during typhoon seasons which create a complex oscillation and torsional movement of the building i.e. building sway. The sway might be barely perceptible to occupants but the roping systems inside lift shafts could be excited to oscillate under the influence of building sway, and in extreme circumstances come to resonance with the sway resulting in severe damages to the installations inside lift shafts.

Figure 9 Sway Control Algorithm

Inputs from high wind Sensor	Control function	Functionality	Duration
Level 0: No Building sway	No sway	Normal operation	Min 5 minutes with <300 displacement
Level 1: Building displacement >=350mm	Low sway Max speed 5m/s (Speed adjustable)	Speed reduction about 50%, critical zones will not be served anymore	>=3 minutes
Level 2: Building displacement >=450mm	Medium sway Max speed 2.5m/s (Speed adjustable)	Further Speed reduction about 25%. Critical zones will not be served anymore	>=3 minutes
Level 3: Building displacement >=600mm	High sway	Elevator evacuates people to main floor and parks at a pre-defined floor (non-resonant floor)	>=3 minutes

Lifts with long roping systems are more susceptible to building sway effects. High wind operation sensors shall be equipped to safeguard the lift installations by means of sway control algorithm.

3.2 DESIGN STANDARD

Despite comprehensive codes and rules available in Mainland China and Hong Kong, those codes and rules are written for single deck conventional lifts with capacities and

speeds not exceeding 1600kg and 3.5m/s.

Ultra-high speed and high capacity double-deck lift system, however, is dominant in super-high rise buildings. The current set of codes and rules fall short of design information of modern lift systems. It is important that engineers shall keep abreast of the new technologies/products launched by lift manufacturers and wisely apply them to super high-rise building projects

3.3 EVACUATION UNDER EMERGENCY

After the 11 September 2001 incident in the United State, it is of great concern to building managers of super high-rise building when time is of the essence in trying to quickly evacuate the occupants in case of bomb scare, terrorist attack or other emergency situations.

Traditionally during fire outbreak, fireman’s lifts will be dedicated for firemen only and pressurized exit stairs will be the only escape routes for occupants. Although refuge floors are designed in every 15 to 25 floors for super high-rise buildings, the tenants have to congregate at refuge floors and wait passively for rescue. While this still holds true for projects in Hong Kong, projects in Mainland China have been using assigned shuttle lifts for evacuation of occupants at high level floors under emergency. When the lifts are switched to evacuation mode, the lifts will serve expressly only between the designated rescue floors and the designated exit floor and all other calls will be inoperative.

3.4 EMERGENCY RESCUE DOORS

Emergency rescue doors, which can provide a safe way to rescue passengers in event of lift failure, are compulsory for lift installations.

In accordance with COP in Hong Kong and GB in Mainland China, if the distance between any two adjacent lift landing doors exceeds 11m, a dedicated emergency rescue door is required on the lift shaft. The emergency rescue door shall be spaced with intermediate interval not exceeding 11m as well.

Besides, GB also allows cab-by-cab rescue as a supplement to the rescue doors. The cab-by-cab rescue method is suitable for multiple lift cabs in common lift shafts which enable rescue of trapped passengers from faulty lift to healthy lift via side rescue doors of size 1.8m high and 0.35m wide at least, subject to the distance between two lift cabs must be not more than 750mm.

3.5 FIREMAN'S LIFT

According to GB, fireman's lift shall be provided for the following buildings:

- Category 1 public building such as hotel, hospital or, office with height more than 50m etc.
- Residential Building with 12 or more storey
- Category 2 building such as hotel, apartment or office etc with height exceeding 32m.

For tall buildings, the minimum number of fireman's lift is determined as follows: -

- 1 unit for serving floor area not exceeding 1500m² GFA;
- 2 units for serving floor area exceeding 1500m² GFA but not exceeding 4500m² GFA;
- 3 units for serving floor area exceeding 4500m² GFA.

As compared with the Hong Kong practice, fireman's lift is required for buildings having 2 or more storeys and with height exceeding 30m and the fireman's lift has to be located at appropriate locations where the distance from the fireman's lift to any part of a floor will not be exceeding 60m.

Figure 10 Fireman's Lift Direction Sign



Regulations of Hong Kong and Mainland China both require the fireman's lift shall be fast enough to reach the topmost discharge point of the building within 60 seconds. Under special circumstances, authority of Mainland China may accept transfer of fireman's lifts at high levels.

Furthermore, in Mainland China, a dedicated sump pit must be provided for each fireman's lift. The holding capacity of sump pit shall not be less than 2m³ as stipulated in GB while there is no such provision required in Hong Kong

3.6 BARRIER FREE ACCESS

Figure 11 Barrier Free Access



Paper No. 5

While regulations of Hong Kong and Mainland China both require assigned lifts be provided with facilities for disabled, there are differences in the provisions:-

Figure 12 Barrier Free Access Requirements Comparison Table Between Hong Kong and Mainland China

	Barrier Free Access 2008 Hong Kong	JGJ 50 - Codes for design on accessibility of urban roads and buildings
Minimum internal dimension of lift cab floor	1200mm x 1100mm	1400mm x 1100mm
Minimum clear entrance width	850mm	800mm
Fixing height of handrail	850mm-950mm	800mm-850mm
Position of control button for disabled use	900mm-1200mm	900mm-1100mm

In Mainland China, in order to facilitate disabled passenger's awareness on the running status of moving lift car, a mirror should be installed above the handrail of the internal wall which is opposite to the car door.

4. CONCLUSION

With Hong Kong reunion with Mainland China since July 1997 and the continual economic boom in Mainland China over the last decade,

engineers of Hong Kong, who are gifted with experience of projects world-wide since the 1980's, get more chances to participate in mega projects in Mainland China.

Of these mega projects, super high-rise buildings supported by highly secure and reliable power supply and state-of-the-art vertical transportation systems are the mainstream developments in Mainland China in the recent decade. Keeping abreast of the regulations and practices of engineering in Mainland China is essential to all engineers of Hong Kong to face the challenges of the 21st century for years to come.

Paper No. 6

**SMART USE OF SYSTEM CONTROL STATISTICAL DATA TO
ENHANCE POWER SYSTEM OPERATIONS**

**Speaker : Mr Dennis K. Wong
Vice President, Business Development
ASAT Solutions Inc., Canada**

SMART USE OF SYSTEM CONTROL STATISTICAL DATA TO ENHANCE POWER SYSTEM OPERATIONS

Mr Dennis K. Wong
Vice President, Business Development
ASAT Solutions Inc., Canada

ABSTRACT

Many utilities implement substation intelligent electronic device (IED) integration and automation projects. In most cases, the focus is on acquiring real-time operational data for supervisory control and data acquisition (SCADA), automation, protection and control applications. However, non-operational data such as fault records, waveform captures, breaker contact wearing, and transformer conditions is also invaluable data for power system operators and utility engineers. Access to the non-operational data is generally not available from the SCADA system. It usually requires access through IED maintenance ports using native IED vendor software. This paper examines the benefits of using non-operational data in the operation, maintenance and management of substation equipment. It also explores the approaches of integrating non-operational data into substation automation projects. By combining real-time operational data and more productive use of non-operational data, utilities can maximize return on investment in substation automation projects and capital assets.

1. INTRODUCTION

Driven by dynamic market environments, utility management and engineering professionals are constantly looking for improvements in power system operation. The Smart Grid initiative is driven by industry regulators, utilities and suppliers in the electric power industry in an enterprise-wide coordinated approach to modernize the aging electric power infrastructure using communication and information technologies for greater reliability and efficiency in electricity supply. In addition to effective operation of power grids, the maintenance and

management of critical substation equipment is equally important in meeting business metrics. Proper use of non-operational data from substation automation systems can produce significant value and benefits in managing these high-value assets.

2. SUBSTATION ASSET MANAGEMENT

Of all industries, the electric power industry has the highest asset value in its infrastructure. Much of the equipment is classified as critical assets to power system operation. According to the North American Electric Reliability Corporation (NERC), critical assets are defined as: facilities, systems, and equipment which, if destroyed, degraded, or otherwise rendered unavailable, would affect the reliability or operability of the bulk electric system. Thus, asset management is vital in today's utilities operation.

Utilities asset management is a broad subject and the asset management paradigm includes:

- maximizing business performance
- using rigorous and data-driven process
- having strategic business goals, to drive engineering and operation decisions
- having multiple considerations:
 - profitability
 - performance
 - reliability
 - risk
 - safety
 - tolerance
 - cash flow

Paper
No. 6

- regulatory relations
- environmental
- customer satisfaction
- employee satisfaction

In brief, asset management involves spending decisions made with the explicit objectives of maximizing business performance while proactively managing risk, budgets, resources and key performance indicators. (Source: R.E. Brown and L. Willis).

In vertically integrated utilities, assets include power system operation-related equipment in generation, transmission and distribution systems, as well as other business operation-related assets. For the purpose of this paper, the focus of discussion is the management of substation assets, including:

1. Apparatus or equipment:

- transformers
- capacitors
- circuit breakers and switches
- other equipment

2. Intelligent Electronic Device (IED):

- protection relays
- remote terminal units (RTU)
- meters
- monitoring sensors
- fault recorders
- programmable logic controller
- other electronics

The maintenance, planning and management of these high value and critical substation assets have a significant impact on the managing utility business. In recent years, utility businesses have shifted from standard-driven to condition-based management of assets.

2.1 STANDARD-DRIVEN MANAGEMENT OF ASSETS

In standard-driven management, equipment standards, as well as operations and

maintenance (O&M) guidelines govern the way we work with equipment. Typical work processes starts from defined standards from which budget and resources are planned accordingly, and then are approved for implementation. Typical practices of equipment maintenance, planning and management include: scheduled inspections, review and work orders, manual data logging or retrieval, planning based on standards and estimates, as well as managing based on experience. While this has been the best practice in the past in order to ensure safety and reliability, it has also presented numerous challenges including:

- intensive resource requirement
- unnecessary maintenance work
- high O&M expenditures
- no visibility between maintenances

2.2 CONDITION-DRIVEN MANAGEMENT OF ASSETS

In condition-based management, assets are monitored on a continuous basis and conditions are assessed through data analysis. Typical work processes include equipment condition monitoring and assessment, prediction of possible scenarios and recommendation of action. Budget and resources are then planned accordingly, and approved for implementation.

This approach needs to use data collected from equipment, and this data is typically non-operational data.

3. OPERATIONAL DATA VS NON-OPERATIONAL DATA

In general, operational data refers to real-time data typically required for the operation of power systems. Operational data attributes focus on what and when, and status and measurements are typically in real time. This data includes circuit breaker open and close statuses, alarms, events with time tags, line currents and bus voltages. The corresponding

action of operational data is protection, control and SCADA. The main users are power system operators.

On other hand, non-operational data is usually historical data, files and records that focus on what and why, and typically include counts, accumulation and trends. This data includes fault and waveform records, circuit breaker operation counts and contact wear, as well as transformer dissolved gas, moisture and temperature. The primary objectives of non-operational data are equipment maintenance, system planning and asset management. The corresponding action of non-operational data is analysis, prediction and planning. The main users are equipment maintenance, asset management, system planning and system operation.

A collection of non-operational data or historical data can be processed, trended, analyzed or fed into modeling algorithms for identifying equipment deterioration or problems. Condition monitoring of equipment empowers decisions about maintenance work, repair or replacement, work order issuance and resource deployment. It facilitates the planning of work, resources, schedules and budgets. Results from non-operational data analysis are also valuable and powerful in supporting and justifying budgets for proper capital expenditure (CAPEX) or operating expenditure (OPEX).

The following are examples of non-operational data that are valuable to utilities managers and engineers in power system operation, maintenance and planning. This data can be

made available from substation IEDs and sensors.

1. Transformer monitoring:

- Dissolved gas in the oil as an incipient of faults:
 - electrical faults from partial discharge and arcing
 - thermal faults from overheating
- On-line dissolved gas analysis (DGA):
 - acetylene (C₂H₂)
 - carbon monoxide (CO)
 - ethylene (C₂H₄)
 - hydrogen (H₂)
- Moisture in the oil:
 - degradation of paper
 - aging insulation
- Transformer monitoring modeling:
 - cooling system efficiency
 - winding apparent power
 - winding hotpot temperature
 - dynamic rating and efficiency

2. Switchgear Monitoring

- Partial discharge monitoring:
 - various sensor technologies are available
 - useful in gas and air-insulated switchgear
 - detects, logs and analyzes partial discharges

Paper No. 6

Table 1 Comparing Operational Data to Non-operational Data

Characteristics	Operational Data	Non-operational Data
<i>Data format</i>	Individual time-sequenced data	Data file, collection of related data
<i>Time dependence</i>	Real-time or near real-time	Historical, trends over time
<i>Data integration</i>	Standard or de facto standard	Proprietary and vendor specific
<i>SCADA as carrier</i>	Easily transportable	Difficult to transport
<i>Accessibility</i>	Accessible and retrievable	Difficult to access, manual retrieve

J.D. McDonald, Substation Integration and Automation

- avoids progressive deterioration of equipment, which ultimately leads to equipment failure
- Gas Monitoring:
 - Pressure, temperature, density, alarm
 - Insulation deterioration
 - Detect early leakage
 - Prevent partial discharge and flashover
- 3. Circuit breaker monitoring:
 - operational count and history
 - time to break or close
 - operation current
 - contact wearing percentage
- 4. Load Tap Changer Monitoring:
 - identify motor and mechanical problems
 - verify proper operation
 - identify contact wear
- 5. Bushing Monitoring:
 - temperature
 - leakage current
- 6. Substation battery:
 - alarm
 - charging current
- 7. IED monitoring and remote maintenance:
 - operational history and data
 - events, fault and waveform records
 - device setting changes
 - communication error logs
 - setting history and update

4. THE BENEFITS OF USING NON-OPERATIONAL DATA FOR CONDITION MONITORING

The benefits of using non-operational data, in combination with operational data, can be significant to utilities engineers and managers. With the ability to access data and information

related to equipment conditions in real-time, performing remote troubleshooting and diagnostics without unnecessary travel to remote sites, as well as analyzing and archiving historical data, utilities can achieve many of the following:

- avoiding catastrophic equipment failure
- reducing unplanned outages
- reducing outage frequency, durations and revenue losses
- implementing condition-based and predictive maintenance
- improving the effectiveness of maintenance planning and work order issuances
- reducing spare parts inventory
- reducing cost and lead time of spare parts purchase
- taking corrective action instead of reactive action
- implementing post-mortem analyses for root cause identifications
- empowering decision making, which is faster and more accurate
- improving human resource utilization and deployment
- optimizing asset and equipment life cycles, hence better return on investment (ROI)
- right-sizing operation and maintenance budgets
- facilitating business planning
- using data and fact-based justifications for CAPEX, OPEX and resource planning
- improving safety, health and environmental measures
- improving relationships with customers, government regulatory organizations and the general public
- reducing insurance premiums

5. ACQUIRING NON-OPERATIONAL DATA

Many modern IEDs are capable of providing both operational and non-operational data. However, making this data available and

accessible is often challenging. While most operational data is available through SCADA communication, non-operational data is typically available only through a physical connection to the IED maintenance port using of vendor proprietary software to extract the data. Such data access is time-consuming, labour intensive, inconvenient, and therefore often not used. Even if the data is available and accessible, it is often not usable due to the proprietary nature of vendor-specific devices and software. Since most of this valuable data exists in substation IEDs and sensors, extracting and utilizing the hidden treasures in the substation, will reap many valuable benefits.


6. IED INTEGRATION

Acquiring operational and non-operational data can be accomplished through IED integration in the substation. According to Newton-Evans Research Company, Inc.'s report, more than 50% of substations are equipped with IEDs. However, fewer than 50% of these substation IEDs are integrated to make the data accessible and usable. IEDs that have valuable data for maintenance and asset management include: RTUs, protection relays, meters, fault recorders, event recorders, as well as monitoring sensors of various types. Data from IEDs should be integrated onto a common platform in the substation to be further processed, utilized and managed.

The following steps can be considered in the integration process:

- define and rank data that has a high impact on the business metrics
- assess existing IEDs and sensors regarding data availability
- review the need for additional IEDs and sensors
- examine IED communication capability
- identify communication protocols used and their compatibility

Figure 1 Integrated Substation Automation System

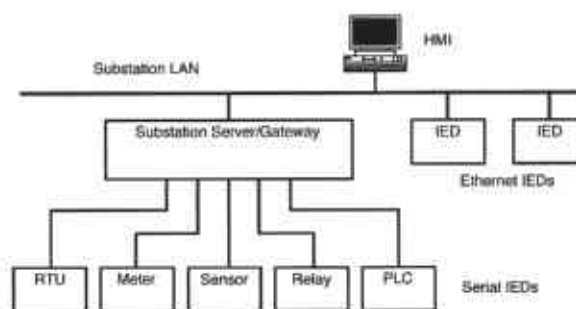

6.1 IED COMMUNICATION INTERFACE


Most substation IEDs are equipped with serial or network communication capability. Typical legacy IEDs have serial communication ports in the form of RS-232 or RS-485. Many IEDs have more than one serial communication channel. One can consider using one channel as the real-time communication channel for operational data and using the second channel as a maintenance channel for non-operational data. If an IED has only one communication channel, then an IED with “inter-leave” capability can be easily integrated. New IEDs with Ethernet interfaces that make integration much easier. High speed Ethernet local area networks (LAN) in substations should be considered in IED integration for handling large amounts of data. Serial IEDs should be consolidated and converted to network communication “capable” devices via data concentrator, communication gateway, terminal sever.

6.2 PROTOCOL SELECTION

Most IEDs communicate using protocol of some form. For real-time operational data, protocols are commonly used, and are a mixture of vendor proprietary and open protocols. In recent years, most IEDs support open protocols such as DNP3.0 or IEC-60870-5-101, 103 and 104. Industry standard de facto protocol such as Modbus is also commonly used. Attention should be given to ensure the compatibility of protocols, or to consider using data concentrators for protocol conversion. For non-operational data, the data is made available

in many ways, such as ASCII-based protocols, datalink or file transfers. “Virtual connection” or “pass through” techniques can be used to establish communication with IEDs using manufacturer software to retrieve data and files from the IEDs.

Figure 2 Non-operational Data via Virtual Connection of Pass Through

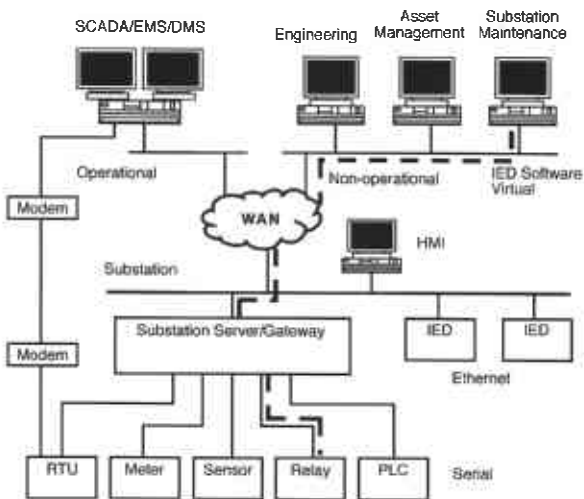

6.3 MULTIPLE DATA PATHS

It is necessary to use multiple data paths to separate real-time operational data and non-operational data. Operational data is real-time, deterministic, mission-critical data, has the highest priority and should not be interrupted by non-operational data. In serial communication, bandwidth is limited for such high volume non-operational data transfers. Also, using a SCADA control center to forward or relay non-operational data unnecessarily burdens the SCADA system and dispatch operators. For network communication, the same philosophy should apply to separate the data into two LANs where there can be two or more physical or virtual LANs in a substation.

Other reasons for separate communication paths include: reducing nuisance alarms to the SCADA control center, accessing security, as well as other operational reasons. In general, data paths for non-operational data is best be separated from the SCADA system and protection communication paths.

6.4 SUBSTATION SERVER PLATFORM

It is important to design a substation system with a hierarchical architecture where data paths, applications and equipment are clearly defined. A substation server that incorporating, data concentrator, communication gateway features for IED integration is necessary in an integrated substation system. In some cases, multiple servers are used for different applications such as condition monitoring and maintenance, protection and control, as well as SCADA and automation.

For condition monitoring and maintenance applications, it is desirable to have a dedicated integrated condition monitoring (ICM) server platform. The substation ICM server is the central platform for integrating all sensors and centralizing all non-operational data within the substations. In reviewing the use of a substation server, the following should be considered:

- the substation hardened server, designed for embedded application with no moving part
- is a true open system with cross-platform capability (i.e. it runs on multiple hardware platforms)
- functions as a substation server, data concentrator, as well as communication gateway
- is equipped with cyber security capability
- supports redundant failover system architecture
- supports open and proprietary protocols
- integrates multiple vendor IEDs
- supports both serial and network communication
- has data collection and consolidation capability
- has data-to-information conversion capability
- has multiple user data distribution capability
- supports virtual connection/pass through to multi-vendor IEDs

- supports data logging, data files and records retrieval
- supports scheduled and event trigger file retrieval
- has temporary data storage
- supports a GPS interface for synchronization
- uses an application programming interface (API) for third-party expert applications

6.5 INFORMATION PRESENTATION AND VISUALIZATION

It is also important that the substation server is equipped with an intuitive and user-friendly graphical user interface (GUI) or human-machine interface (HMI). No matter how comprehensive the system data is, only a system with a good HMI application will be extensively used. Some of the HMI elements to be considered are:

- embedded HMI integrated with the substation server
- local graphical display in the substation
- remote graphical display and access
- web browser based
- user configurable and maintainable
- object library and device templates
- configurable user/group privilege
- cyber security
- ease of use

7. SYSTEM SECURITY


As the number of users accessing the system increases, it is necessary to implement security measures to restrict and manage user access. User activities logging and reporting should also be included. Access security features can be integrated in the substation server. It can also be implemented at the enterprise level. Each approach has its advantages and disadvantages. Access authentication should be implemented to secure all user access portals including but not limited to access

through SCADA, HMI, direct or virtual connection to IED maintenance port, as well as operating system level access.

Cyber security features that should be considered including:

- Definition for individual and group users and privileges
- Unique user names and passwords
- User authentication
- Access authorization
- Activity log and report
- Data encryption and secured file transfer
- Secured web browser
- Interface to enterprise security servers
- Capable of disable unused communication ports and services
- User administration and management tools

Figure 3 Securing the Integrated Substation Automation System

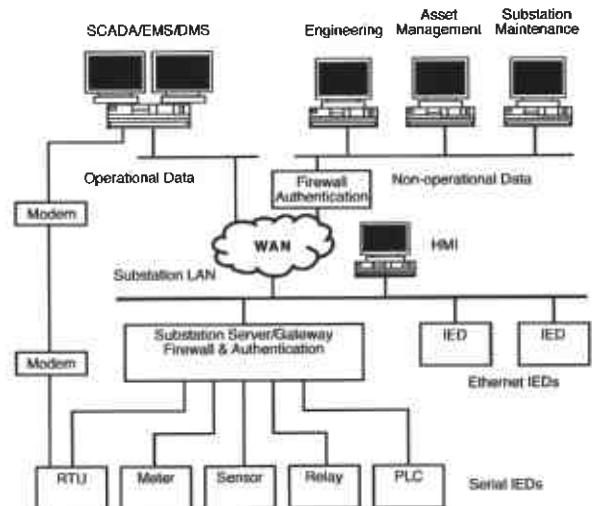

Regardless of security implementation at the substation or enterprise level, centralized user administrative tools and utilities software should be considered for effective system management.

Network security features such as firewall as well as procedural implementation are also necessary securing the substation system.

Other techniques can also be considered. For

instance, substation server can be used to automatically acquire data or files from IEDs in a scheduled or event driven manner. The data and files are temporarily stored in the substation server. The substation server can then notify users and made data and files available for retrieval through HMI and web browser interface. This approach reduce direct access to IEDs by users and therefore reduces security risk.

Many utilities in North America is adopting the NERC CIP (North America Electricity Reliability Corporation, Critical Infrastructure Protection) Standards in improving cyber security in the utilities infrastructure. Utilities in other regions and countries can also reference the standards for bench marking.

8. CONCLUSION

In conclusion, by leveraging substation automation projects and systems, IED integration and non-operational data, utility managers and engineers can greatly benefit from many aspects of the utility business, including:

- leveraging priceless data and information
- faster respond time
- empowering decision making
- reducing unnecessary trips to sites
- right-sizing resources, CAPEX and OPEX
- optimizing resource utilization
- optimizing asset utilization
- optimizing equipment operation efficiency
- optimizing system efficiency, reduces energy losses and fuel costs
- maximizing return on assets (ROA) and ROI
- reducing unplanned outages
- reducing revenue losses
- facilitate operation and capital planning
- supporting and justifying budgets

- increasing earnings and profitability
- migrating to a Smart Grid

Since most substation IEDs in operation - such as protection relays, RTUs, meters, sensors, PLCs, event and fault recorders - already have large amounts of non-operational data stored in the IED, one can further leverage substation integration projects to realize greater value of the existing equipment in operation. Additional sensors for plant equipment monitoring and diagnostics can also be introduced and integrated into the same system for even greater benefits.

REFERENCES

- [1] Brown, R.E. and Lee W., *Substation Asset Management, Electric Power Substations Engineering, Second Edition*
- [2] McDonald, J.D., *Substation Integration and Automation, Electric Power Substations Engineering, Second Edition*
- [3] Kwan, M., *Migration Strategies for Enabling the Smart Grid*
- [4] Kreiss, D.G., *Intelligent Correlation And Analysis of Substation Non-operational Data, Power Engineering Society General Meeting, 2004. IEEE, Publication Date:6-10 June 2004, 724- 726 Vol. 1*
- [5] Miller, R.H. and Malinowski, J.H., *Power System Operation, McGraw-Hill International, Third Edition*
- [6] North American Electric Reliability Council, *Critical Infrastructure Protection (NERC CIP) Standards*
- [7] North American Electric Reliability Council (NERC), *Standards Glossary of Terms*
- [8] Newton-Evans Research Company, Inc., *Substation Automation Market - North America*

Paper No. 7

**FIBRE BRAGG GRATING SENSOR NETWORKS FOR
CONDITION-MONITORING OF RAILWAY SYSTEM**

**Speaker : Professor H.Y. Tam
Director
Photonics Research Centre
The Hong Kong Polytechnic University**